


**TYPICAL RANCH SECTION**


SCALE: 1/2" = 1'-0"

ALL ITEMS TO BE VERIFIED BY CONTRACTOR

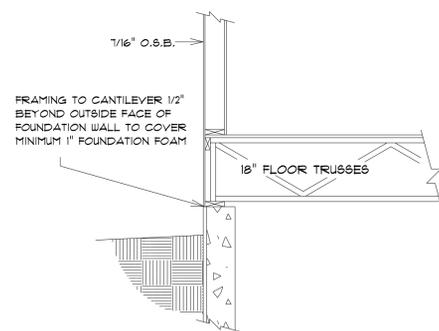

**BOX SILL DETAIL**

SCALE: 1/2" = 1'-0"

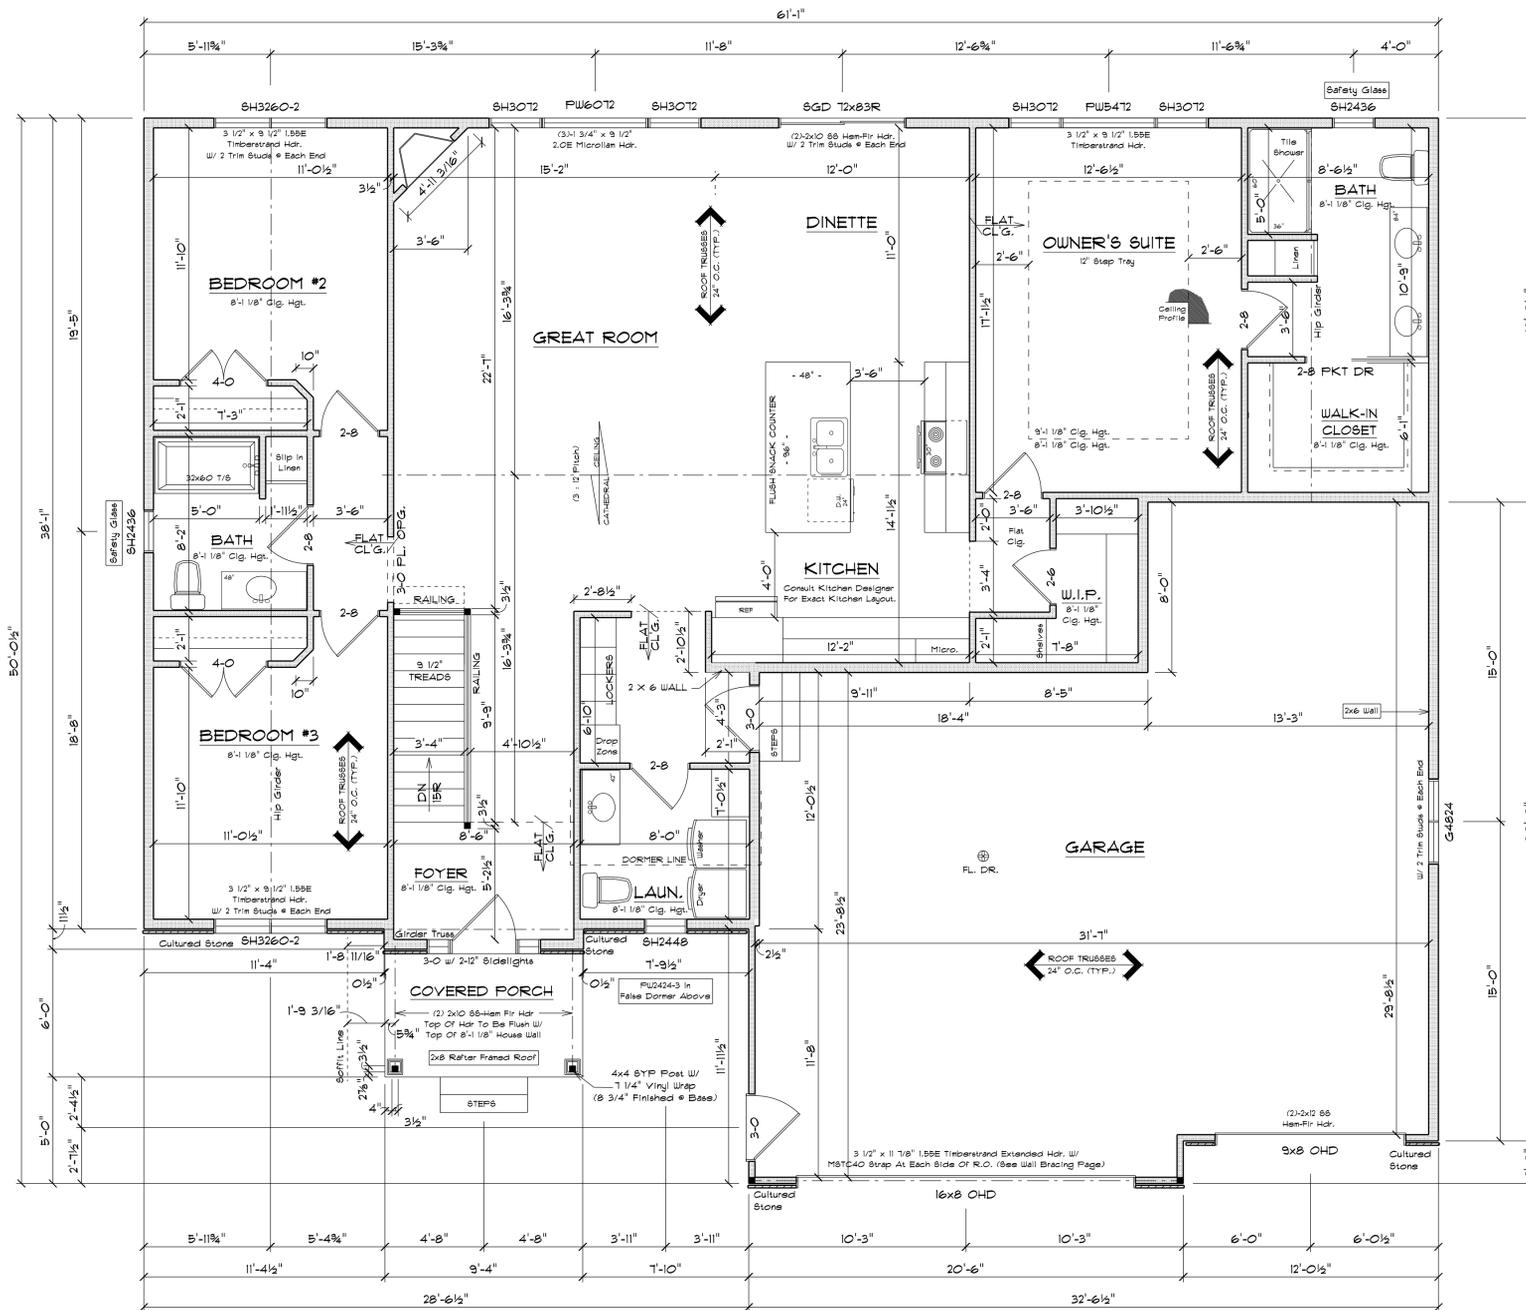

**FLOOR PLAN**

SCALE: 1/4" = 1'-0"

8'-1 1/8" CLG. HGT.

**SQUARE FOOTAGE:**

FIRST FLOOR:	1840
FUTURE BASEMENT:	59
GARAGE:	861
COVERED PORCH:	56

**PLAN SPECIFICATIONS:**

• THE CONDITIONS LISTED BELOW ARE STANDARD FOR THIS PLAN ONLY - EXCEPTIONS ARE NOTED ON THE PLAN ITSELF

**WALL INFORMATION:**  
HOUSE FOUNDATION: 8" x 8'-0" FORMED CONCRETE  
GARAGE FOUNDATION: 6" x 4'-0" FORMED CONCRETE  
PORCELIAN FOUNDATION: 6" x 8" FORMED CONCRETE, MIN. 4'-0" TALL  
HOUSE EXTERIOR: FIRST FLOOR: 2 x 4 x 8'-1 1/8", STUDS @ 16" O.C.  
SECOND FLOOR: N/A  
HOUSE INTERIOR: FIRST FLOOR: 2 x 4 x 8'-1 1/8", STUDS @ 16" O.C.  
SECOND FLOOR: N/A  
GARAGE: 2 x 4 x 9'-3 3/8", STUDS @ 16" O.C.  
• TALL WALLS ARE EXTERIOR WALLS WITH STUDS TALLER THAN 10'-0" AND NEED TO BE DESIGNED BY ENGINEERED WOOD PRODUCTS SUPPLIER  
• TAPEDED WALLS ARE TO BE FRAMED TO UNDERSIDE OF SCISSOR ROOF TRUSSES

**STAIR INFORMATION:**  
BASEMENT TO FIRST FLOOR: 15 RISERS @ 7 1/2" x 14" TREADS @ 9 1/2"  
FIRST FLOOR TO SECOND FLOOR: N/A  
BASEMENT TO GARAGE: N/A  
FLOOR SYSTEM(S):  
BASEMENT: 4" REINFORCED CONCRETE SLAB  
FIRST FLOOR: 18" FLOOR TRUSSES @ 16" O.C.  
SECOND FLOOR: N/A  
STD. LOADING (PER SQ. FT.):  
10' TOLL, 10' TOLL, 5' BCDL  
ADDITIONAL LOADING (PER SQ. FT.):  
10' TOLL FOR TILE FLOOR  
20' TOLL FOR GRANITE  
DEFLECTION: LLL/480 D/L/240  
DURATION OF LOAD: 100%  
FRAMER TO REFERENCE L018/TRUS6 LAYOUT PLANS TO VERIFY EXACT SIZE AND LOCATION OF ALL FLUSH HEADERS AND BEAMS IN FLOOR SYSTEM  
ROOF SYSTEM:  
ENGINEERED WOOD TRUSSES @ 24" O.C. DESIGNED FOR BRUN COUNTY - ZONE #2  
STD. LOADING (PER SQ. FT.):  
30' TOLL, 10' TOLL, 10' BCDL  
DEFLECTION: LLL/240 D/L/180  
DURATION OF LOAD: 100%  
FRAMER TO REFERENCE TRUS6 LAYOUT PLANS TO VERIFY EXACT LOCATIONS OF GIRDER TRUSSES AND THEIR RESPECTIVE BEARING REQUIREMENTS + UPLIFT ANCHORING REQUIREMENTS  
HEADERS:  
• STD. HEADERS: (2) 2X10 4EM-FIR SELECT STRUCTURAL W/ 2X FLAT  
• TOP OF WINDOW R.O.S.  
FIRST FLOOR @ 6'-1 3/8" ABOVE SUBFLOOR  
MINIMUM OF (2) TRIM STUDS AT EACH END FOR ALL HEADERS 6'-0" AND LARGER  
WINDOWS:  
• ALLIANCE VINYL WINDOWS  
• MANUFACTURER TO PROVIDE SUPPLIER WITH EXACT R.O. SIZES AND DETAILS. SUPPLIER TO VERIFY THAT ALL CODE REQUIREMENTS ARE MET.  
GENERAL INFORMATION:  
• THE FOLLOWING ITEMS ARE TO BE LOCATED IN THE FOUNDATION BY THE GENERAL CONTRACTOR:  
BASEMENT WINDOWS  
ELECTRIC SERVICES  
WATER HEATER  
SUMP PUMP + PUMP FURNACE  
• BUILDER TO PROVIDE HEADERS AT CONCRETE OPENINGS IF NOT NOTED ON THE FOUNDATION PLAN  
POURED CONCRETE FOOTINGS TO BEAR ON UNDISTURBED SOIL BELOW THE FOOT LINE  
STEEL COLUMNS TO SUPPORT 12000#  
• INTERIOR BEARING WALLS TO SIT ON CONTINUOUS CONCRETE FOOTINGS STUDS @ 16" O.C. WITH BLOCKING OR LATERAL BRACING  
• CONCRETE CONTRACTOR AND BUILDER ARE RESPONSIBLE TO DETERMINE SITE SOIL CONDITIONS AND FOLLOW STANDARDS PER SPS 320.24. THE MOST RESTRICTIVE STANDARDS OF SPS 32.25 - SPS 32.18, ACI 318-14, AND ACI 330.4 FOR ALL FOOTING + WALL REINFORCEMENT. IF NEEDED, MUST BE FOLLOWED  
• ASSUMED SOIL CAPACITY IS 3,000 PSF. FTG. SIZES MUST BE ADJUSTED FOR VARYING SITE DETERMINED SOIL BEARING CONDITIONS  
• ALL LUMBER IN PERMANENT CONTACT W/ CONCRETE MUST BE PRESURE TREATED LUMBER AS PER SPS 320.10  
• DUE TO UNKNOWN GRADE CONDITIONS, ACTUAL STEPS IN FOUNDATION WALLS AND LOCATION OF WINDOW WELLS TO BE DETERMINED ON SITE BY GENERAL CONTRACTOR  
FRAMER IS RESPONSIBLE FOR TRANSFERRING POINT LOADS FROM ABOVE THROUGH THE FLOOR SYSTEM(S) AND WALLS W/ SOLID BLOCKING DOWN TO CONCRETE FOUNDATION WALLS BELOW  
• PLAN IS DRAWN ACCORDINGLY FOR 3/4" CASING  
• ALL DIMENSIONS SHOWN ARE FROM 810 TO 810  
• BUILDER TO PROVIDE ATTIC SCUTTLE AND LOCATION  
• FIRE SEPARATION MUST BE PROVIDED BETWEEN HOUSE AND GARAGE (SEE CODE FOR DETAILS)  
• ALL CABINET LAYOUTS ARE CONCEPTUAL. CONSULT CABINET DESIGNER/ PROVIDER FOR EXACT SIZES AND LOCATIONS OF CABINETS, APPLIANCES, AND WINDOWS

**NOTE:**  
EXTERIOR DIMENSIONS ARE SHOWN TO REFLECT HOUSE FRAMING WALLS HELD OUT 1/2" FOR EXTERIOR WALL SHEATHING TO FLUSH OUT WITH 1" FOUNDATION FOAM. IF FOUNDATION FOAM IS TO BE OTHER THAN 1", FRAMING DIMENSIONS ARE TO BE FIELD ADJUSTED AND MAINTAIN ALL CODE COMPLIANCE ACCORDINGLY.

**NOTE:**  
BUILDER RESPONSIBLE TO TRANSFER POINT LOADS FROM ABOVE THROUGH THE FLOOR SYSTEM, AND OTHER WALLS WITH SOLID BLOCKING TO FOUNDATION WALLS BELOW

**C.R.I. DEVELOPMENT**

CUSTOMER DESIGNED FOR:

JOB NAME: 885 Jessema Way (Lot 45)  
(Tru Motion)

DATE: January 23, 2026

REVISIONS:

DRAWN BY: Annie Spaulke

SCALE: 1/4" = 1'-0"

26-021R

**IMPORTANT NOTE:**  
IT IS AGREED THAT ALTHOUGH EVERY EFFORT HAS BEEN MADE IN PREPARING AND CHECKING THESE PLANS FOR ACCURACY, THE GENERAL CONTRACTOR/OWNER MUST REVIEW ALL DIMENSIONS, DETAILS AND NOTES BEFORE BEGINNING ANY CONSTRUCTION AND IS HEREBY HELD RESPONSIBLE FOR ANY DISCOVERED DISCREPANCIES.  
• IT IS UNDERSTOOD THAT THE WISCONSIN SAFETY AND PROFESSIONAL SERVICES CODE AND LAYOUT DRAWINGS FOR FLOOR AND ROOF TRUSSES SHALL TAKE FINAL PRECEDENCE OVER THESE ARCHITECTURAL PLANS.

MAILING ADDRESS:  
P.O. BOX 10001  
GREEN BAY, WI 54307-0001

OFFICE:  
GREEN BAY, WI 54303  
GREEN BAY, WI 54303  
PHONE (920) 486-5080  
PHONE (920) 484-9570  
FAX (920) 486-2178



**SQUARE FOOTAGE:**


FIRST FLOOR:	1840
FUTURE BASEMENT:	59
GARAGE:	861
COVERED PORCH:	56

**PLAN SPECIFICATIONS:**

THE CONDITIONS LISTED BELOW ARE STANDARD FOR THIS PLAN ONLY - EXCEPTIONS ARE NOTED ON THE PLAN ITSELF


**WALL INFORMATION:**  
HOUSE FOUNDATION: 8" x 8" FOAMED CONCRETE  
GARAGE FOUNDATION: 6" x 4" FOAMED CONCRETE  
PORCUPINATION FOUNDATION: 6" x 8" FOAMED CONCRETE, MIN. 4'-0" TALL  
HOUSE EXTERIOR: FIRST FLOOR: 2" x 6" x 8'-1 1/8", STUDS @ 16" O.C.  
SECOND FLOOR: N/A  
HOUSE INTERIOR: FIRST FLOOR: 2" x 4" x 8'-1 1/8", STUDS @ 16" O.C.  
SECOND FLOOR: N/A  
GARAGE: 2" x 4" x 9'-3 3/8", STUDS @ 16" O.C.  
-TALL WALLS ARE EXTERIOR WALLS WITH STUDS TALLER THAN 10'-0" AND NEED TO BE DESIGNED BY ENGINEERED WOOD PRODUCTS SUPPLIER  
-TAPERED WALLS ARE TO BE FRAMED TO UNDERSIDE OF BOBBERG ROOF TRUSSES

**STAIR INFORMATION:**  
BASEMENT TO FIRST FLOOR: 15 RISERS @ 7 1/4" x 14" TREADS @ 9 1/2" FIRST FLOOR TO SECOND FLOOR: N/A  
BASEMENT TO GARAGE: N/A  
**FLOOR SYSTEM(S):**  
BASEMENT: 4" REINFORCED CONCRETE SLAB  
FIRST FLOOR: 18" FLOOR TRUSSES @ 16" O.C.  
SECOND FLOOR: N/A  
ST. LOADING (PER SQ. FT.): 40' TOLL, 10' TCDL, 10' BCCL  
ADDITIONAL LOADING (PER SQ. FT.): 10' TCDL FOR TILE FLOOR, 20' TCDL FOR GRANITE  
DEFLECTION: LLL/480 D-L/240  
DURATION OF LOAD: 1.00H  
FRAMER TO REFERENCE JOIST/TRUSS LAYOUT PLANS TO VERIFY EXACT SIZE AND LOCATION OF ALL FLUSH HEADERS AND BEAMS IN FLOOR SYSTEM  
**ROOF SYSTEM:**  
ENGINEERED WOOD TRUSSES @ 24" O.C. DESIGNED FOR BRONX COUNTY - ZONE #2  
ST. LOADING (PER SQ. FT.): 30' TOLL, 10' TCDL, 10' BCCL  
DEFLECTION: LLL/240 D-L/180  
DURATION OF LOAD: 1.00H  
FRAMER TO REFERENCE TRUSS LAYOUT PLANS TO VERIFY EXACT LOCATIONS OF GIRDER TRUSSES AND THEIR RESPECTIVE BEARING REQUIREMENTS + UPLIFT ANCHORING REQUIREMENTS  
**HEADERS:**  
- STD. HEADERS: (2) 2X10 HEIF-R SELECT STRUCTURAL W/ 2X FLAT  
- TOP OF WINDOW R.O.S.  
- FIRST FLOOR @ 6'-1 1/8" ABOVE SUBFLOOR  
- MINIMUM (2) TRUSS STUDS AT EACH END FOR ALL HEADERS 6'-0" AND LARGER  
**WINDOWS:**  
- ALLIANCE VINYL WINDOWS  
- MANUFACTURER TO PROVIDE SUPPLIER WITH EXACT R.O. SIZES AND DETAILS. SUPPLIER TO VERIFY THAT ALL CODE REQUIREMENTS ARE MET.  
**GENERAL INFORMATION:**  
- THE FOLLOWING ITEMS ARE TO BE LOCATED IN THE FOUNDATION BY THE GENERAL CONTRACTOR:  
BASEMENT WINDOWS  
ELECTRIC SERVICES  
WATER HEATER  
PUMP PIT + PUMP  
FURNACE  
- BUILDER TO PROVIDE HEADERS AT CONCRETE OPENINGS IF NOT NOTED ON THE FOUNDATION PLAN  
- POURED CONCRETE FOOTINGS TO BEAR ON UNDISTURBED SOIL BELOW THE FOOT LINE  
- STEEL COLUMNS TO SUPPORT 12,000#  
- INTERIOR BEARING WALLS TO SIT ON CONTINUOUS CONCRETE FOOTINGS STUDS @ 4' O.C. WITH BLOCKING OR LATERAL BRACING  
- CONCRETE CONTRACTOR AND BUILDER ARE RESPONSIBLE TO DETERMINE SITE SOIL CONDITIONS AND FOLLOW STANDARDS PER SP8 320.24. THE MOST RESTRICTIVE STANDARDS OF SP8 320.25 - SP8 321.18, ACI 318.14, AND ACI 330.4 FOR ALL FOOTINGS + WALL REINFORCEMENT. IF NEEDED, MUST BE FOLLOWED  
- ASSUMED SOIL CAPACITY IS 3,000 PSF. FTG SIZES MUST BE ADJUSTED FOR VARYING SITE DETERMINED SOIL BEARING CONDITIONS  
- ALL LUMBER IN PERMANENT CONTACT W/ CONCRETE MUST BE PRESURURE TREATED LUMBER AS PER SP8 320.10  
- DUE TO UNKNOWN GRADE CONDITIONS, ACTUAL STEPS IN FOUNDATION WALLS AND LOCATION OF WINDOW WELLS TO BE DETERMINED ON SITE BY GENERAL CONTRACTOR  
- FRAMER IS RESPONSIBLE FOR TRANSFERRING POINT LOADS FROM ABOVE, THROUGH THE FLOOR SYSTEM(S) AND WALLS, W/ SOLID BLOCKING DOWN TO CONCRETE FOUNDATION WALLS BELOW  
- PLAN IS DRAWN ACCORDINGLY FOR 3/4" CASING  
- ALL DIMENSIONS SHOWN ARE FROM STD. TO STD.  
- BUILDER TO PROVIDE ATTIC SCUTLE AND LOCATION  
- FIRE SEPARATION MUST BE PROVIDED BETWEEN HOUSE AND GARAGE (SEE CODE FOR DETAILS)  
- ALL CABINET LAYOUTS ARE CONCEPTUAL. CONSULT CABINET DESIGNER/ PROVIDER FOR EXACT SIZES AND LOCATIONS OF CABINETS, APPLIANCES, AND WINDOWS

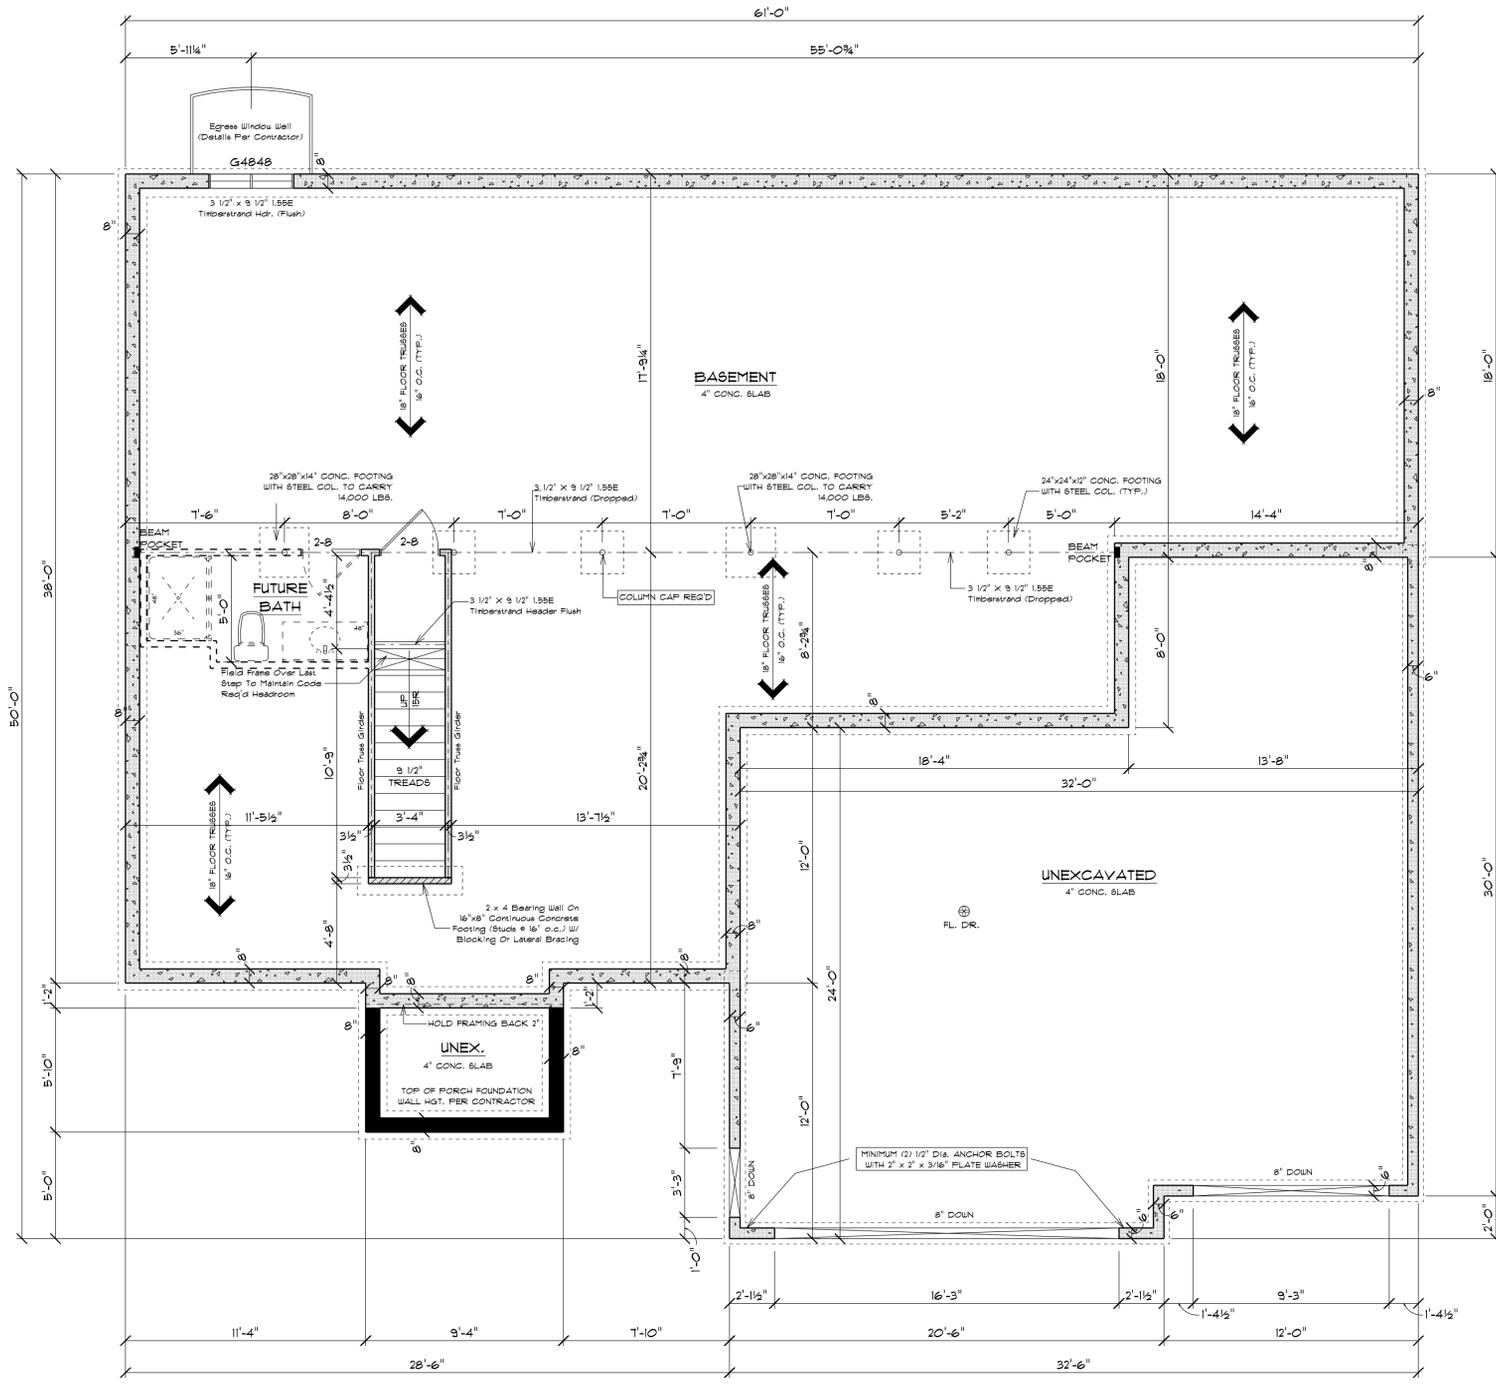


**FOUNDATION PLAN**

SCALE: 1/4" = 1'-0"  
8'-0" FOUNDATION WALL HGT.

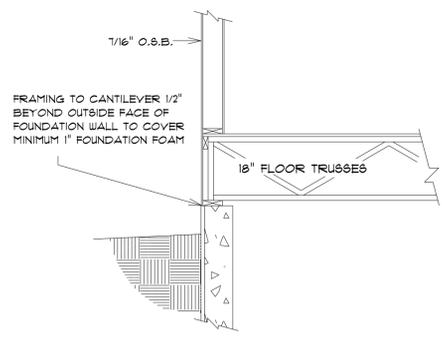

**BOX SILL DETAIL**  
SCALE: 1/2" = 1'-0"

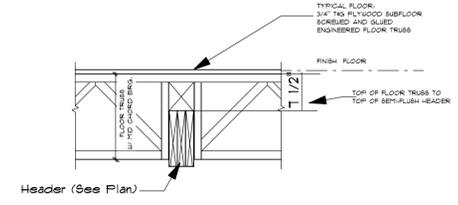

**SEMI-FLUSH HEADER DETAIL**  
NOT TO SCALE

**NOTE:**  
EXTERIOR DIMENSIONS ARE TO FACE OF FOUNDATION WALLS. EXTERIOR FRAMED HOUSE WALLS ARE TO BE HELD OUT 1/2" TO FLUSH WALL SHEATHING OUT WITH 1" FOUNDATION FOAM

**NOTE:**  
BUILDER RESPONSIBLE TO TRANSFER POINT LOADS FROM ABOVE THROUGH THE FLOOR SYSTEM, AND OTHER WALLS WITH SOLID BLOCKING DOWN TO FOUNDATION WALLS BELOW

**WISCONSIN BUILDING SUPPLY**

**MAILING ADDRESS:**  
P.O. BOX 10001  
GREEN BAY, WI 54307-0001

**OFFICE:**  
WISCONSIN BUILDING SUPPLY  
GREEN BAY, WI 54303  
PHONE (920) 436-5080  
FAX (920) 436-5084

**COMPONENTS:**  
WISCONSIN BUILDING SUPPLY  
GREEN BAY, WI 54303  
PHONE (920) 436-5080  
FAX (920) 436-5084

**CUSTOMER SERVICE:**  
WISCONSIN BUILDING SUPPLY  
GREEN BAY, WI 54303  
PHONE (920) 436-5080  
FAX (920) 436-5084

**IMPORTANT NOTE:**  
IT IS AGREED THAT ALTHOUGH EVERY EFFORT HAS BEEN MADE IN PREPARING AND CHECKING THESE PLANS FOR ACCURACY, THE GENERAL CONTRACTOR/OWNER MUST REVIEW ALL DIMENSIONS, DETAILS AND NOTES BEFORE BEGINNING ANY CONSTRUCTION AND IS HEREBY HELD RESPONSIBLE FOR ANY DISCOVERED DISCREPANCIES.  
IT IS UNDERSTOOD THAT THE WISCONSIN SAFETY AND PROFESSIONAL SERVICES CODE AND LAYOUT DRAWINGS FOR FLOOR AND ROOF TRUSSES SHALL TAKE PRECEDENCE OVER THESE ARCHITECTURAL PLANS.

**REVISIONS:**

NO.	DATE	DESCRIPTION
1	JANUARY 23, 2026	ISSUED OFF OF PLAN #26-021R

**26-021R**

**C.R.I. DEVELOPMENT**

**JOB NAME:** 888 Jessamine Way (Lot 45) (The Martens)  
**DATE:** January 23, 2026  
**DRAWN BY:** Annie Schuik  
**SCALE:** 1/4" = 1'-0"

SQUARE FOOTAGE:	
FIRST FLOOR:	1840
FUTURE BASEMENT:	59
GARAGE:	861
COVERED PORCH:	56

### WALL BRACING LAYOUT PLAN

Scale: 1/4" = 1'-0"  
 House Wall Ht.: 8'-1 1/8"  
 Garage Wall Ht.: 9'-9 3/8"  
 Top-Of-Wall-To-Ridge Ht.: 11'-5 5/8"  
 Exterior Stud Spacing: 16" O.C.  
 Seismic Design: B

### GENERAL NOTES:

- WALL BRACING, SPS 321.25 (8)
- <> CIRCUMSCRIBED RECTANGLES AROUND THE ENTIRE FLOOR PLAN AT THE FLOOR LEVEL UNDER CONSIDERATION. WHEN MULTIPLE RECTANGLES ARE USED, EACH SIDE SHALL BE BRACED AS THOUGH IT WERE A SEPARATE BUILDING AND THE BRACING AMOUNT ADDED TOGETHER ALONG THE COMMON WALL WHERE ADJACENT RECTANGLES OVERLAP OR ABUT.
  - <> EACH RECTANGLE SHALL HAVE A MAXIMUM RECTANGLE LENGTH-TO-WIDTH RATIO OF 3:1.
  - <> BRACED WALL PANEL (BWP) LOCATIONS: WITHIN 12'-6" FROM EACH SIDE AND 2'-0" PANEL EDGE TO PANEL EDGE (SEE FIGURE 321.25-C).
  - <> ALL EDGES OF PANEL-TYPE BRACING, EXCEPT HORIZONTAL JOINTS IN GB BRACING, SHALL BE ATTACHED TO FRAMING OR BLOCKING.
  - <> THE INTERIOR SIDE OF ALL EXTERIOR WALLS SHALL BE SHEATHED WITH MINIMUM 1/2" GYPSUM WALLBOARD UNLESS OTHERWISE PERMITTED TO BE EXCLUDED BY THIS SUBSECTION. (THIS REQUIREMENT IS EXCLUDED IN PORTAL FRAME METHOD).
  - <> BRACING WITH CS-WSP SHALL HAVE SHEATHING INSTALLED ON ALL SHEATHABLE SURFACES ABOVE, BELOW, AND BETWEEN WALL OPENINGS.
  - <> EACH BRACED WALL PANEL MAY CONTAIN NO MORE THAN ONE HOLE, HAVING A MAXIMUM DIMENSION OF NO MORE THAN TEN PERCENT OF THE LEAST DIMENSION OF THE PANEL, AND CONFINED TO THE MIDDLE THREE-FORTHS OF THE PANEL.
  - <> BLOCKING AND BRIDGING: 2x18 BRIDGING USED AT PARALLEL BOX SILL AND FLOOR JOIST BRIDGING (8' 3/4" O.C.) IS THE SAME DEPTH AS THE JOIST.
  - <> WHERE JOISTS ARE PERPENDICULAR TO BWL'S ABOVE OR BELOW, BLOCKING SHALL BE PROVIDED BETWEEN THE JOISTS AT BWP LOCATIONS TO PERMIT FASTENING OF WALL PLATES WITH 16d NAILS @ 16" O.C.
  - <> WHERE JOISTS ARE PARALLEL TO BWL'S ABOVE OR BELOW A RM JOIST OR OTHER PARALLEL FRAMING MEMBER SHALL BE PROVIDED AT THE BWP TO PERMIT FASTENING OF WALL PLATES WITH 16d NAILS @ 16" O.C.

### WALL BRACING MATERIAL LEGEND


- CS-WSP: CONTINUOUSLY SHEATHED WOOD STRUCTURAL PANEL; 3/8" THICK SHEATHING FOR MAX. 16' o.c. STUD SPACING; 1/8" THICK SHEATHING FOR MAX. 24' o.c. STUD SPACING; FASTEN WITH 8d COMMON NAIL OR 8d BOX NAIL, 12 3/8" LONG x 0.13" DIA.; OR 1 1/8" x 1 1/2" - CROWN 16 GAGE STAPLES, 1 1/4" LONG TRAP-NAIL FASTENER BRACING; 6" EDGES, 12" FIELD (NAILS) / 3" EDGES, 6" FIELD (STAPLES).
- CS-PF: CONTINUOUSLY SHEATHED PORTAL FRAME; REFER TO FIGURE 321.25-A FOR SHEATHING, FASTENER, AND OTHER REQUIREMENTS.

### TABLE 321.25-H ab MINIMUM WIDTHS OF CS-WSP BRACED WALL PANELS

MAXIMUM OPENING HEIGHT ADJACENT TO BRACED WALL PANEL	MINIMUM LENGTH OF FULL-HEIGHT BRACED WALL PANEL (INCHES)			
	8' TALL WALL	9' TALL WALL	10' TALL WALL	12' TALL WALL
5' - 4"	24	27	30	36
6' - 0"	32	30	30	36
7' - 2" (7' 0" Gr. Dr.)	38	35	33	36
8' - 0"	48	41	38	36
8' - 2" (8' 0" Gr. Dr.)	-	43	39	37
9' - 0"	-	54	46	41
10' - 0"	-	-	60	48
12' - 0"	-	-	-	72

a. SHEATHING SHALL EXTEND FROM TOP OF THE TOP PLATE TO THE BOTTOM PLATE AND MAY BE MULTIPLE SHEETS. ALL JOINTS SHALL BE BLOCKED.  
 b. INTERPOLATION IS PERMITTED.

### FIGURE 321.25-A PF / CS-PF - PORTAL FRAME BRACE CONSTRUCTION

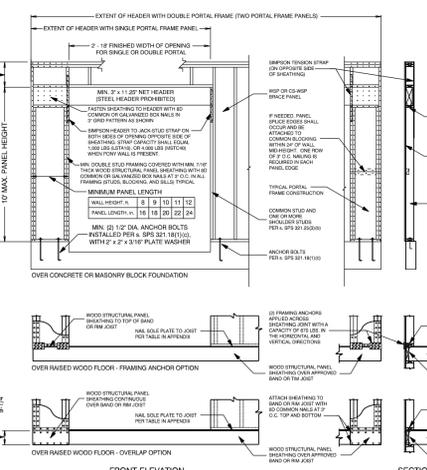

NOTE: STEEL HEADERS ARE PERMITTED IF DESIGNED BY STRUCTURAL ANALYSIS.  
 NOTE: AS SHOWN IN THE ABOVE CROSS SECTION, 1/2" GYPSUM WALL BOARD IS NOT REQUIRED ON THE EXTERIOR SIDE OF THE WALL.

C.R.I. DEVELOPMENT  
 JOB NAME: 885 Jessema Way (Lot 45)  
 DATE: January 23, 2026  
 DRAWN BY: Annie Bonhais  
 REVISIONS:  
 26-021R  
 C.I. #  
 ISSUED OFF OF  
 PLAN 15-021R


IMPORTANT NOTE:  
 \* IT IS AGREED THAT ALTHOUGH EVERY EFFORT HAS BEEN MADE IN PREPARING AND CHECKING THESE PLANS FOR ACCURACY, THE GENERAL CONTRACTOR/OWNER MUST REVIEW ALL DIMENSIONS, DETAILS AND NOTES BEFORE BEGINNING ANY CONSTRUCTION, AND IS HEREBY HELD RESPONSIBLE FOR ANY DISCOVERED DISCREPANCIES.  
 \* IT IS UNDERSTOOD THAT THE WISCONSIN SAFETY AND PROFESSIONAL SERVICES CODE AND LAYOUT DRAWINGS FOR FLOOR AND ROOF TRUSSES SHALL TAKE PRECEDENCE OVER THESE ARCHITECTURAL PLANS.

MAILING ADDRESS:  
 P.O. BOX 10001  
 GREEN BAY, WI 54307-1001  
 COMPONENTS:  
 GREEN BAY, WI 54303  
 GREEN BAY, WI 54303  
 PHONE: (920) 436-5080  
 PHONE: (920) 436-5084  
 FAX: (920) 436-5078

**Wisconsin**  
 BUILDING SUPPLY

TOTAL ADJACENT SIDE LENGTH: 50'-0 1/2"  
 BRACING METHOD: CONTINUOUSLY SHEATHED  
 EXPOSURE CATEGORY: C  
 TOTAL PANEL LENGTH REQUIRED: 9'-1"  
 TOTAL PANEL LENGTH PROVIDED: 12'-0"

Interpolation of Table 321.25-J Was Performed To Achieve Req'd Bracing Length

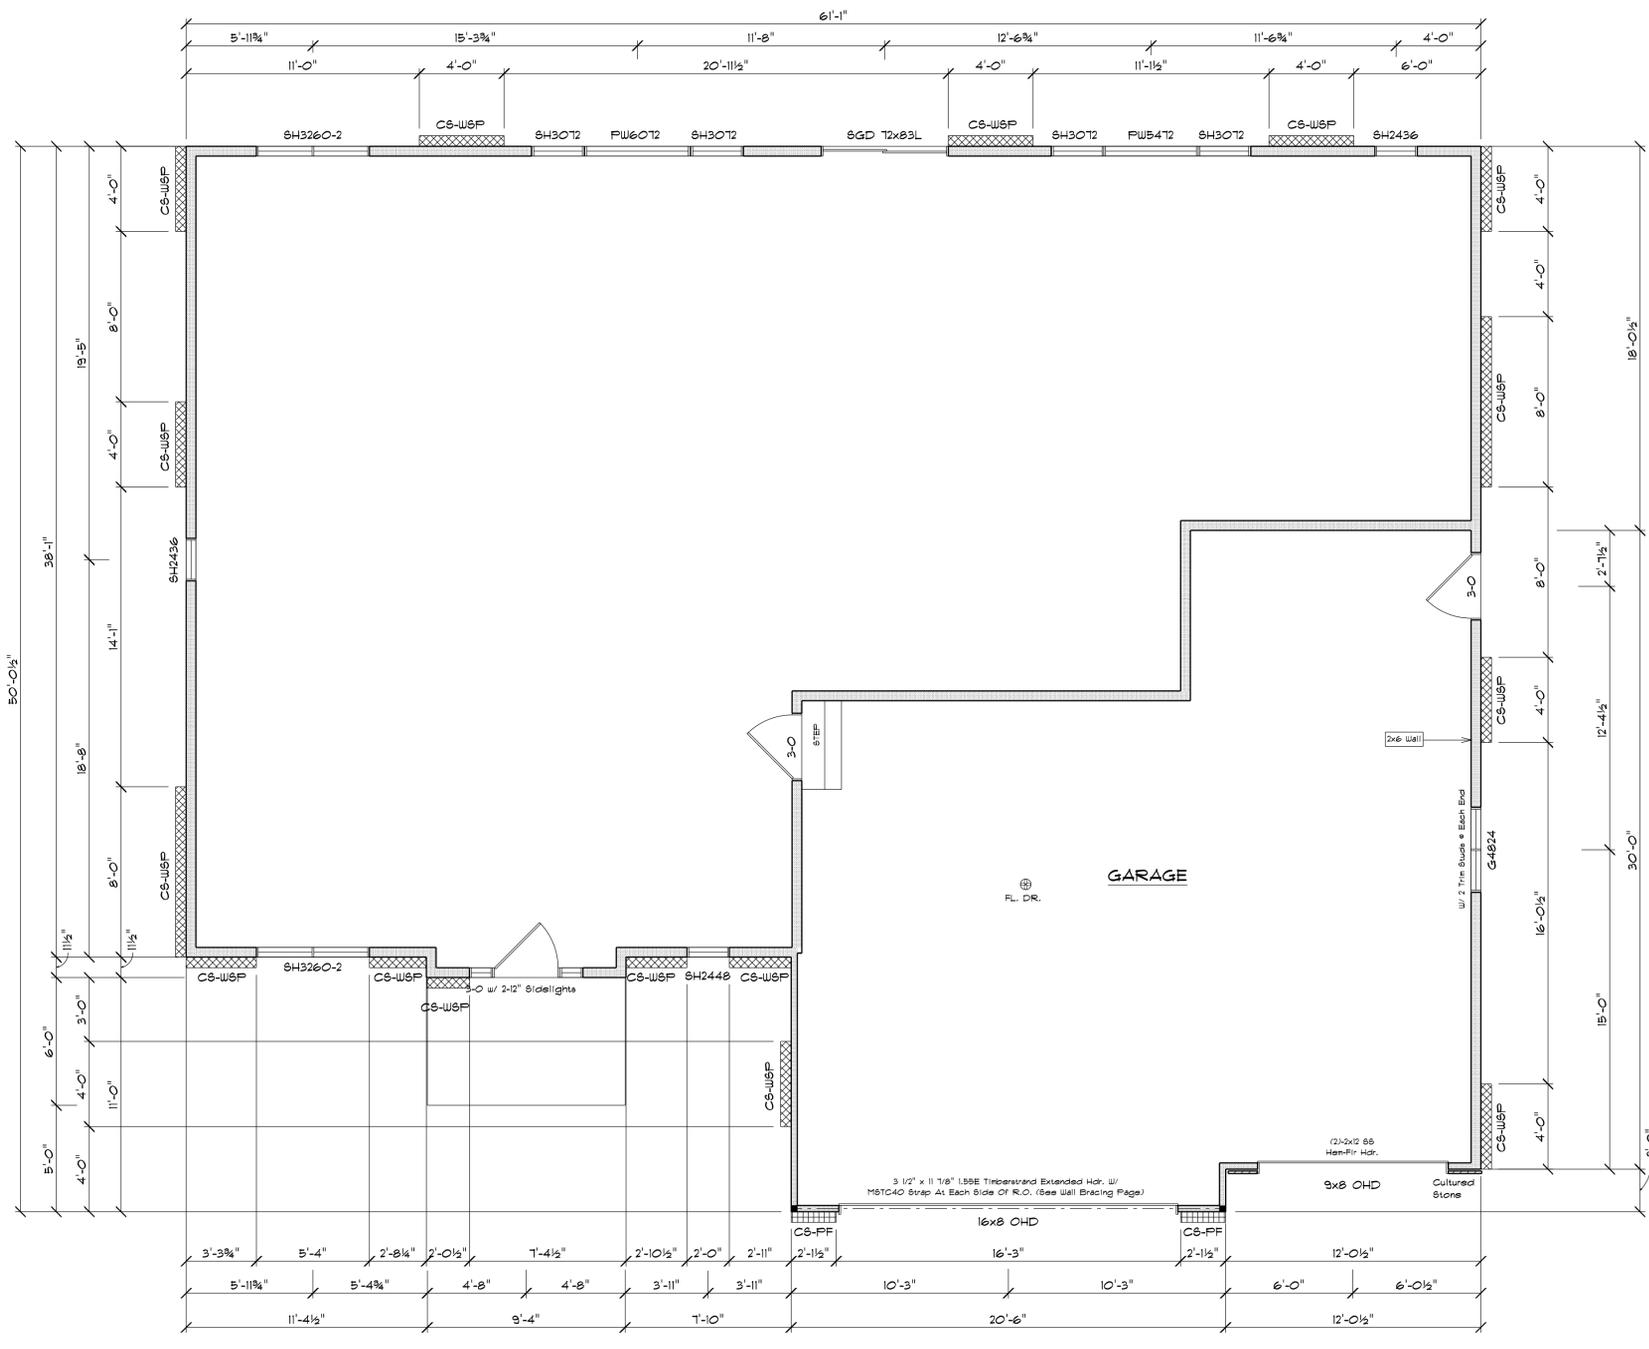

TOTAL ADJACENT SIDE LENGTH: 50'-0 1/2"  
 BRACING METHOD: CONTINUOUSLY SHEATHED  
 EXPOSURE CATEGORY: C  
 TOTAL PANEL LENGTH REQUIRED: 18'-1"  
 TOTAL PANEL LENGTH PROVIDED: 20'-0"

Interpolation of Table 321.25-J Was Performed To Achieve Req'd Bracing Length

TOTAL ADJACENT SIDE LENGTH: 46'-11 1/2"  
 BRACING METHOD: CONTINUOUSLY SHEATHED  
 EXPOSURE CATEGORY: C  
 TOTAL PANEL LENGTH REQUIRED: 19'-7"  
 TOTAL PANEL LENGTH PROVIDED: 22'-0"

Interpolation of Table 321.25-J Was Performed To Achieve Req'd Bracing Length

### FLOOR PLAN 8'-1 1/8" CLG. HGT.

TOTAL ADJACENT SIDE LENGTH: 50'-0 1/2"  
 BRACING METHOD: CONTINUOUSLY SHEATHED  
 EXPOSURE CATEGORY: C  
 TOTAL PANEL LENGTH REQUIRED: 14'-11"  
 TOTAL PANEL LENGTH PROVIDED: 18'-1"

Interpolation of Table 321.25-J Was Performed To Achieve Req'd Bracing Length

**NOTE:**  
 THIS FLOOR PLAN TO BE USED FOR WALL BRACING PURPOSES ONLY