




SQUARE FOOTAGE:	
FIRST FLOOR:	1869
GARAGE:	854
COVERED PORCHES:	168
FUTURE FIN. BASEMENT:	950

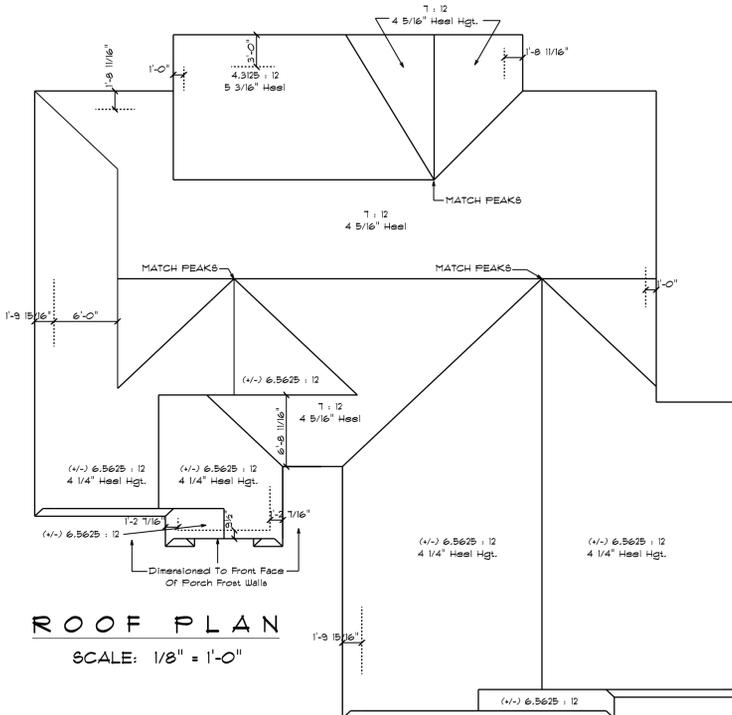

ROOF PLAN
SCALE: 1/8" = 1'-0"

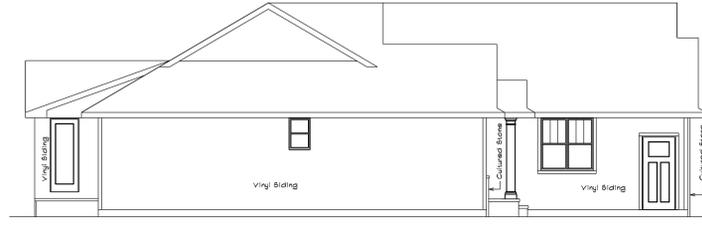

LEFT ELEVATION
SCALE: 1/8" = 1'-0"

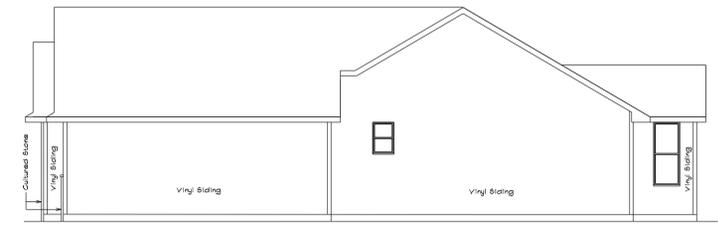

RIGHT ELEVATION
SCALE: 1/8" = 1'-0"



REAR ELEVATION
SCALE: 1/8" = 1'-0"



FRONT ELEVATION
SCALE: 1/4" = 1'-0"

IMPORTANT NOTE:
 * IT IS AGREED THAT ALTHOUGH EVERY EFFORT HAS BEEN MADE IN PREPARING AND CHECKING THESE PLANS FOR ACCURACY, THE GENERAL CONTRACTOR/OWNER MUST REVIEW ALL DIMENSIONS, DETAILS AND NOTES BEFORE BEGINNING ANY CONSTRUCTION AND IS HEREBY HELD RESPONSIBLE FOR ANY DISCOVERED DISCREPANCIES.
 * IT IS UNDERSTOOD THAT THE WISCONSIN SAFETY AND PROFESSIONAL SERVICES CODE AND LAYOUT DRAWINGS FOR FLOOR AND ROOF TRUSSES SHALL TAKE FINAL PRECEDENCE OVER THESE ARCHITECTURAL PLANS.

MAILING ADDRESS:
 P.O. BOX 0001
 GREEN BAY, WI 54307-0001
 OFFICE:
 GREEN BAY, WI 54303
 GREEN BAY, WI 54303
 PHONE (920)436-5080
 FAX (920)434-9570
 COMPONENTS: TRUSSES
 GREEN BAY, WI 54303
 PHONE (920)436-5080
 FAX (920)434-9570

Wisconsin
BUILDING SUPPLY


CUSTOMER DESIGNED FOR: **CRI Development**
 JOB NAME: 2781 Stator Dr. (Lot 63) The Barfield
 DATE: February 2, 2026
 DRAFTER: Annie Schuele
 PLAN NO: 26-028-R
 (BASED OFF OF PLAN 26-018-R)



SQUARE FOOTAGE:	
FIRST FLOOR:	1869
GARAGE:	854
COVERED PORCHES:	168
FUTURE FIN. BASEMENT:	950

PLAN SPECIFICATIONS:

- THE CONDITIONS LISTED BELOW ARE STANDARD FOR THIS PLAN ONLY - EXCEPTIONS ARE NOTED ON THE PLAN ITSELF
- WALL INFORMATION:**
 - HOUSE FOUNDATION: 8" x 8" POURED CONCRETE
 - GARAGE FOUNDATION: 6" x 4" POURED CONCRETE
 - PERCAPIATION FOUNDATION: 8" FIGURED CONCRETE MIN. 4'-0" TALL
 - HOUSE EXTERIOR: FIRST FLOOR: 2 x 4 x 8'-1 1/8" STUDS @ 16" O.C.
 - HOUSE INTERIOR: FIRST FLOOR: 2 x 4 x 8'-1 1/8" STUDS @ 16" O.C.
 - GARAGE: 2 x 4 x 8'-1 1/8" STUDS @ 16" O.C.
 - TALL WALLS ARE EXTERIOR WALLS WITH STUDS TALLER THAN 10'-0" AND NEED TO BE DESIGNED BY ENGINEERED WOOD PRODUCTS SUPPLIER
 - TAPERED WALLS ARE TO BE FRAMED TO UNDERSIDE OF SCISSORS ROOF TRUSSES
- STAIR INFORMATION:**
 - BASEMENT TO FIRST FLOOR: 15 RISERS @ 1 1/8" - 14 TREADS @ 9 1/2"
- FLOOR SYSTEM(S):**
 - BASEMENT: 4" REINFORCED CONCRETE SLAB
 - FIRST FLOOR: 18" FLOOR TRUSSES @ 16" O.C. STD. LOADING (PER SQ. FT.) 40# TOLL, 10# TOLL, OR BCLD. ADDITIONAL LOADING (PER SQ. FT.): 10# TOLL FOR TILE FLOOR 20# TOLL FOR GRANITE
 - DEFLECTION: LLL/480 D/L/240
 - DURATION OF LOAD: 100%
 - FRAMER TO REFERENCE 10187/TRUSS LAYOUT PLANS TO VERIFY EXACT SIZE AND LOCATION OF ALL FLUSH HEADERS AND BEAMS IN FLOOR SYSTEM
- ROOF SYSTEM:**
 - ENGINEERED WOOD TRUSSES @ 24" O.C. DESIGNED FOR BRUN COUNTY - ZONE #2
 - STD. LOADING (PER SQ. FT.): 30# TOLL, 10# TOLL, OR BCLD.
 - DEFLECTION: LLL/240 D/L/180
 - DURATION OF LOAD: 100%
 - FRAMER TO REFERENCE TRUSS LAYOUT PLANS TO VERIFY EXACT LOCATIONS OF GIRDER TRUSSES AND THEIR RESPECTIVE BEARING REQUIREMENTS & UPLIFT ANCHORING REQUIREMENTS
- HEADERS:**
 - STD. HEADERS: (2) 2X10 HEM-FIR SELECT STRUCTURAL WITH 2X PLAT
 - TOP OF WINDOW R.O.S.
 - FIRST FLOOR @ 6'-11 3/8" ABOVE SUBFLOOR
 - MINIMUM OF (2) TRIM STUDS AT EACH END FOR ALL OPENINGS 6'-0" AND LARGER
- WINDOWS:**
 - ALLIANCE VINYL WINDOWS
 - MANUFACTURER TO PROVIDE SUPPLIER WITH EXACT R.O. SIZES AND DETAILS. SUPPLIER TO VERIFY THAT ALL CODE REQUIREMENTS ARE MET.
- GENERAL INFORMATION:**
 - THE FOLLOWING ITEMS ARE TO BE LOCATED IN THE FOUNDATION BY THE GENERAL CONTRACTOR:
 - BASEMENT WINDOWS
 - FLOOR DRAINS
 - ELECTRIC SERVICES
 - WATER HEATER
 - BUMP PIT & PUMP
 - FURNACE
 - BUILDER TO PROVIDE HEADERS AT CONCRETE OPENINGS IF NOT NOTED ON THE FOUNDATION PLAN
 - POURED CONCRETE FOOTINGS TO BEAR ON UNDISTURBED SOIL BELOW THE FROST LINE
 - STEEL COLUMNS TO SUPPORT 1000#
 - INTERIOR BEARING WALLS TO SIT ON CONTINUOUS CONCRETE FOOTINGS STUDS @ 16" O.C. WITH BLOCKING OR LATERAL BRACING
 - CONCRETE CONTRACTOR AND BUILDER ARE RESPONSIBLE TO DETERMINE SITE SOIL CONDITIONS AND FOLLOW STANDARDS PER 809.302.4. THE MOST RESTRICTIVE STANDARDS OF 809.302.5 - 809.302.8, ACI 308-14, AND ACI 308-14 FOR ALL FOOTING & WALL REINFORCEMENT. IF NEEDED, MUST BE FOLLOWED.
 - ASSUMED SOIL CAPACITY IS 3,000 PSF. FTG SIZES MUST BE ADJUSTED FOR VARYING SITE DETERMINED SOIL BEARING CONDITIONS
 - ALL LUMBER IN PERMANENT CONTACT W/ CONCRETE MUST BE PRESSURE TREATED LUMBER AS PER U/ 809.302.10 DUE TO UNKNOWN GRADE CONDITIONS. ACTUAL STEPS IN FOUNDATION WALLS AND LOCATION OF WINDOW WELLS TO BE DETERMINED ON SITE BY GENERAL CONTRACTOR
 - FRAMER IS RESPONSIBLE FOR TRANSFERRING FRONT LOADS FROM ABOVE THROUGH THE FLOOR SYSTEM(S) AND WALLS W/ SOLID BLOCKING DOWN TO CONCRETE FOUNDATION WALLS BELOW
 - PLAN IS DRAWN ACCORDINGLY FOR 3 1/4" CASING
 - ALL DIMENSIONS SHOWN ARE FROM STUD TO STUD
 - BUILDER TO PROVIDE ATTIC SCOTCHES AND LOCATION
 - FIRE SEPARATION MUST BE PROVIDED BETWEEN HOUSE AND GARAGE (SEE CODE FOR DETAILS)
 - ALL CABINET LAYOUTS ARE CONCEPTUAL. CONSULT CABINET DESIGNER/ PROVIDER FOR EXACT SIZES AND LOCATIONS OF CABINETS, APPLIANCES, AND WINDOWS

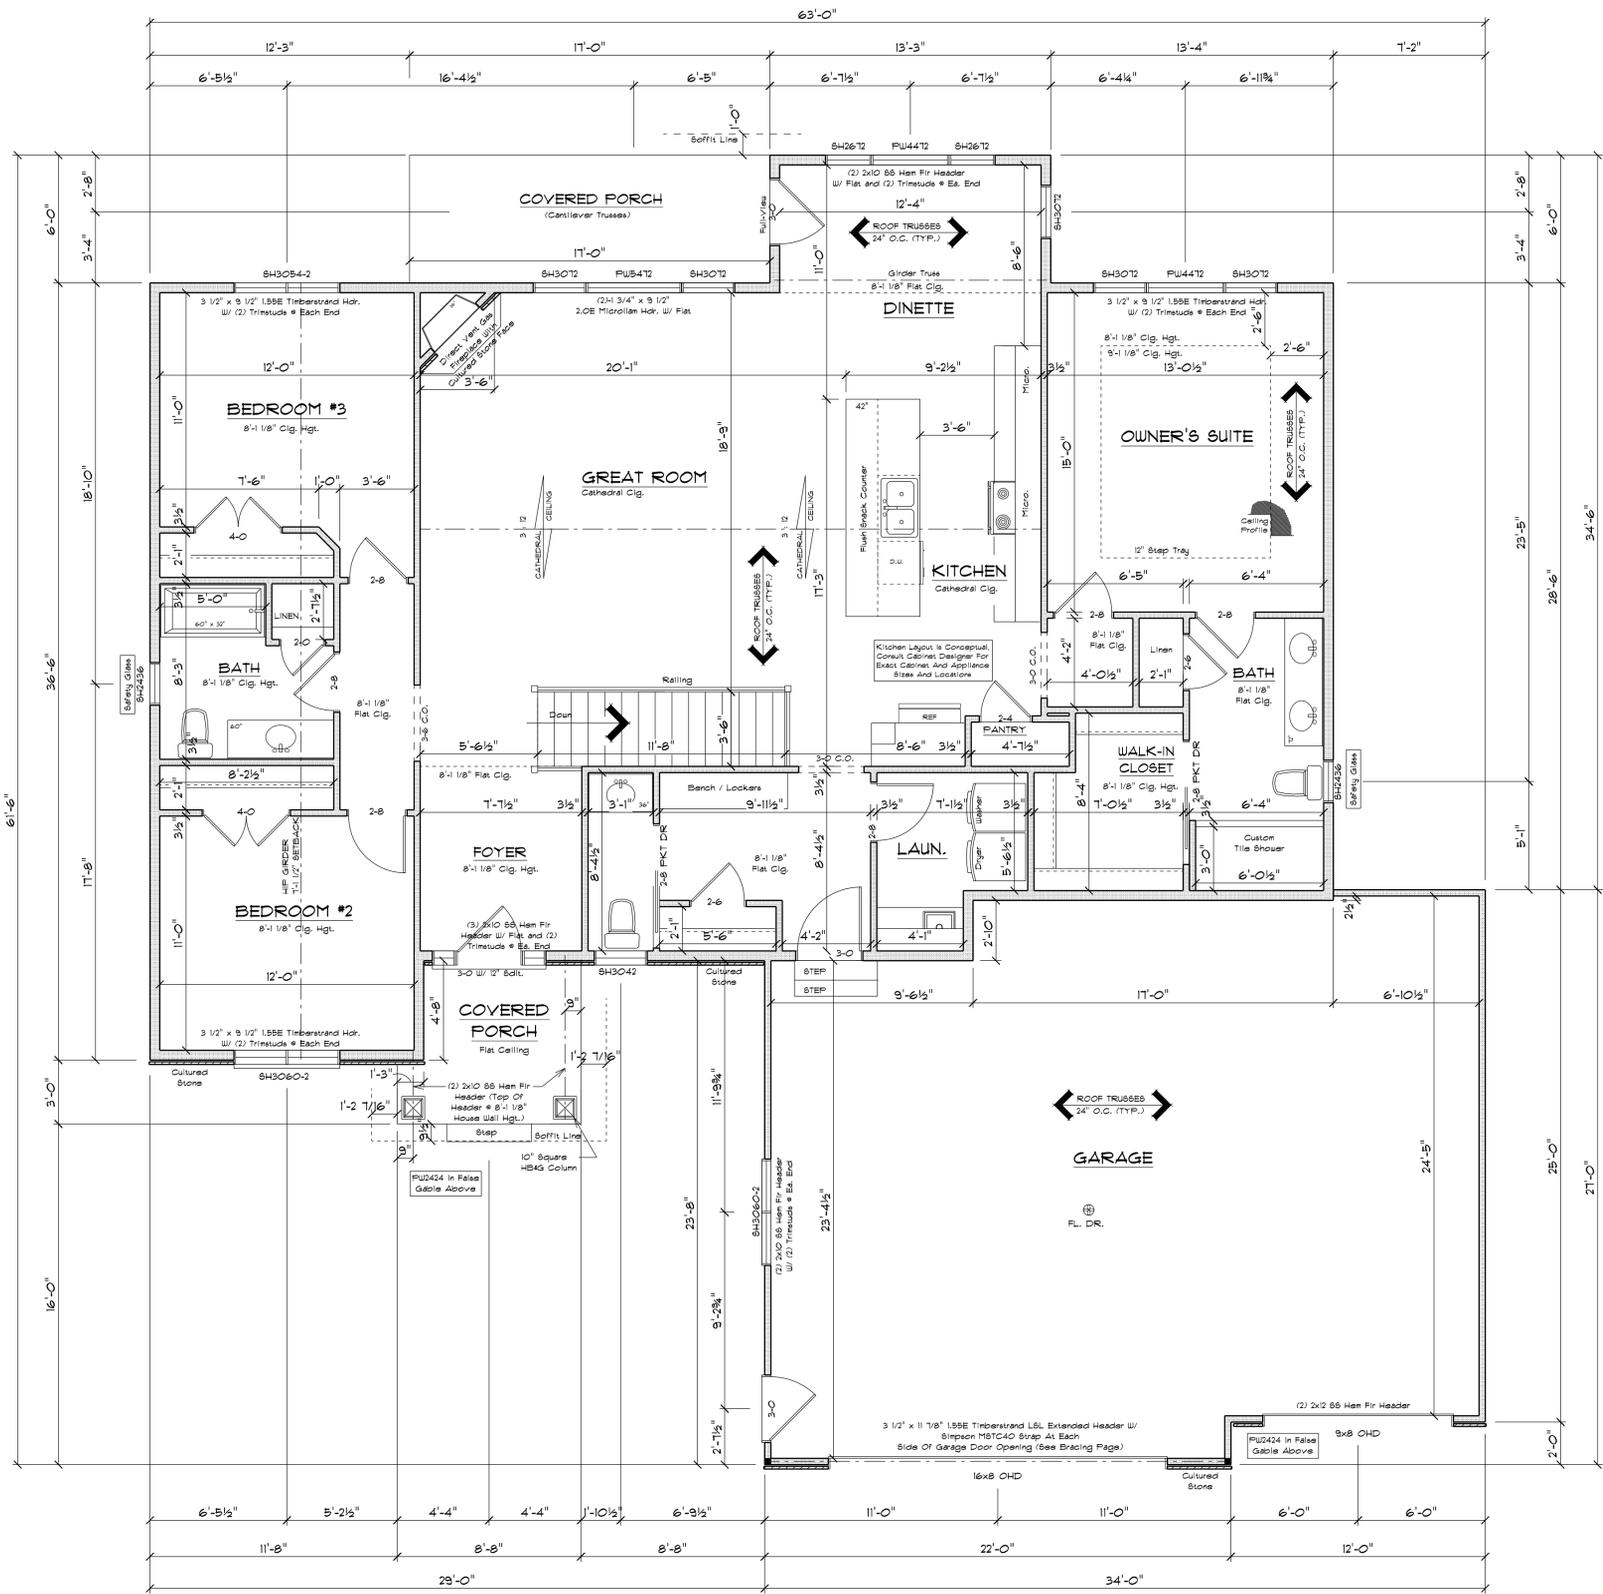


FLOOR PLAN

SCALE: 1/4" = 1'-0"
8'-1 1/8" CLG. HGT.

NOTE:
EXTERIOR DIMENSIONS ARE SHOWN TO REFLECT HOUSE FRAMED WALLS TO BE FLUSH WITH EXTERIOR FACE OF HOUSE FOUNDATION WALLS

NOTE:
BUILDER RESPONSIBLE TO TRANSFER POINT LOADS FROM ABOVE THROUGH THE FLOOR SYSTEM, AND OTHER WALLS WITH SOLID BLOCKING DOWN TO FOUNDATION WALLS BELOW

BOX SILL DETAIL
SCALE: 1/2" = 1'-0"

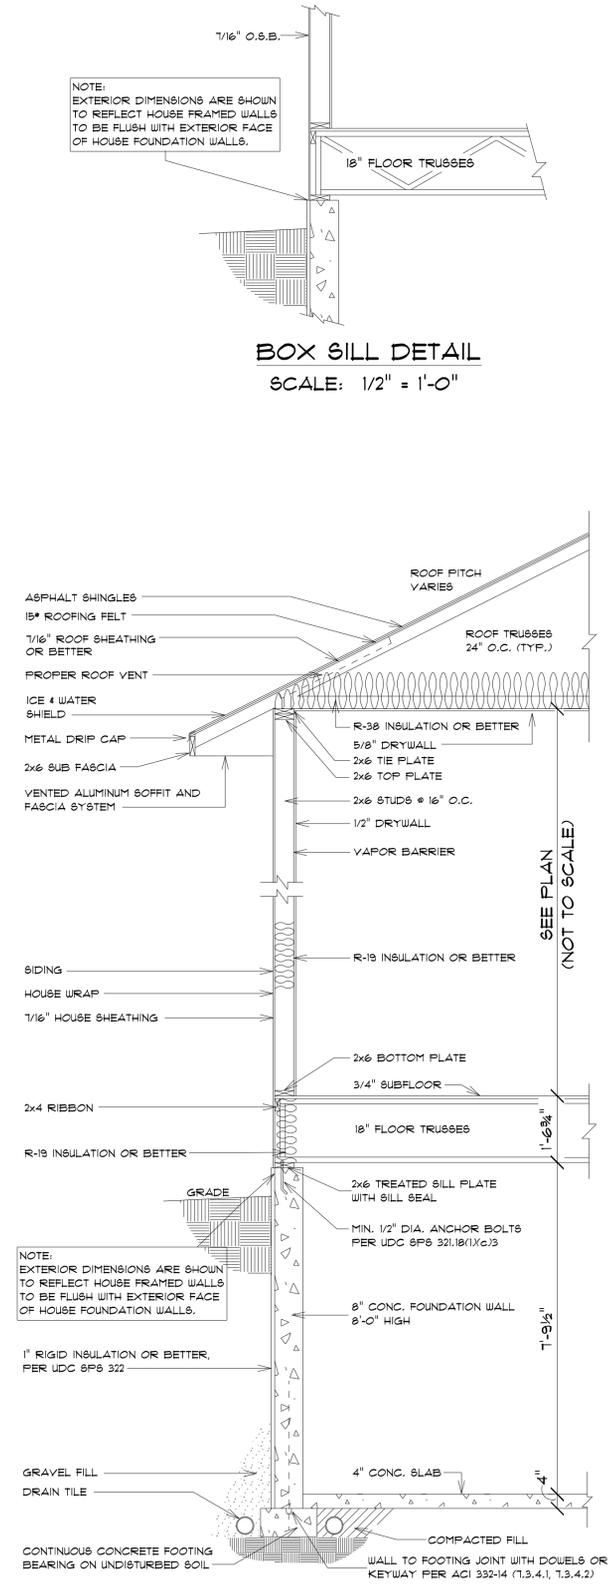

TYPICAL RANCH SECTION
SCALE: 1/2" = 1'-0"

ALL ITEMS TO BE VERIFIED BY CONTRACTOR


CUSTOM DESIGNED FOR:
JOB NAME: 27th Stator Dr. (Lot 63)
DATE: February 2, 2026
DRAWN BY: Annie Schuele
REVISIONS:
26-028-R



IMPORTANT NOTE:
IT IS AGREED THAT ALTHOUGH EVERY EFFORT HAS BEEN MADE IN PREPARING AND CHECKING THESE PLANS FOR ACCURACY, THE GENERAL CONTRACTOR/OWNER MUST REVIEW ALL DIMENSIONS, DETAILS AND NOTES BEFORE BEGINNING ANY CONSTRUCTION AND IS HEREBY HELD RESPONSIBLE FOR ANY DISCOVERED DISCREPANCIES.
IT IS UNDERSTOOD THAT THE WISCONSIN SAFETY AND PROFESSIONAL SERVICES CODE AND LAYOUT DRAWINGS FOR FLOOR AND ROOF TRUSSES SHALL TAKE FINAL PRECEDENCE OVER THESE ARCHITECTURAL PLANS.

MAILING ADDRESS:
P.O. BOX 10001
GREEN BAY, WI 54307-0001
OFFICE:
LARSSEN ROAD
GREEN BAY, WI 54303
PHONE (920)436-5080
PHONE (920)436-5084
FAX (920)436-5078



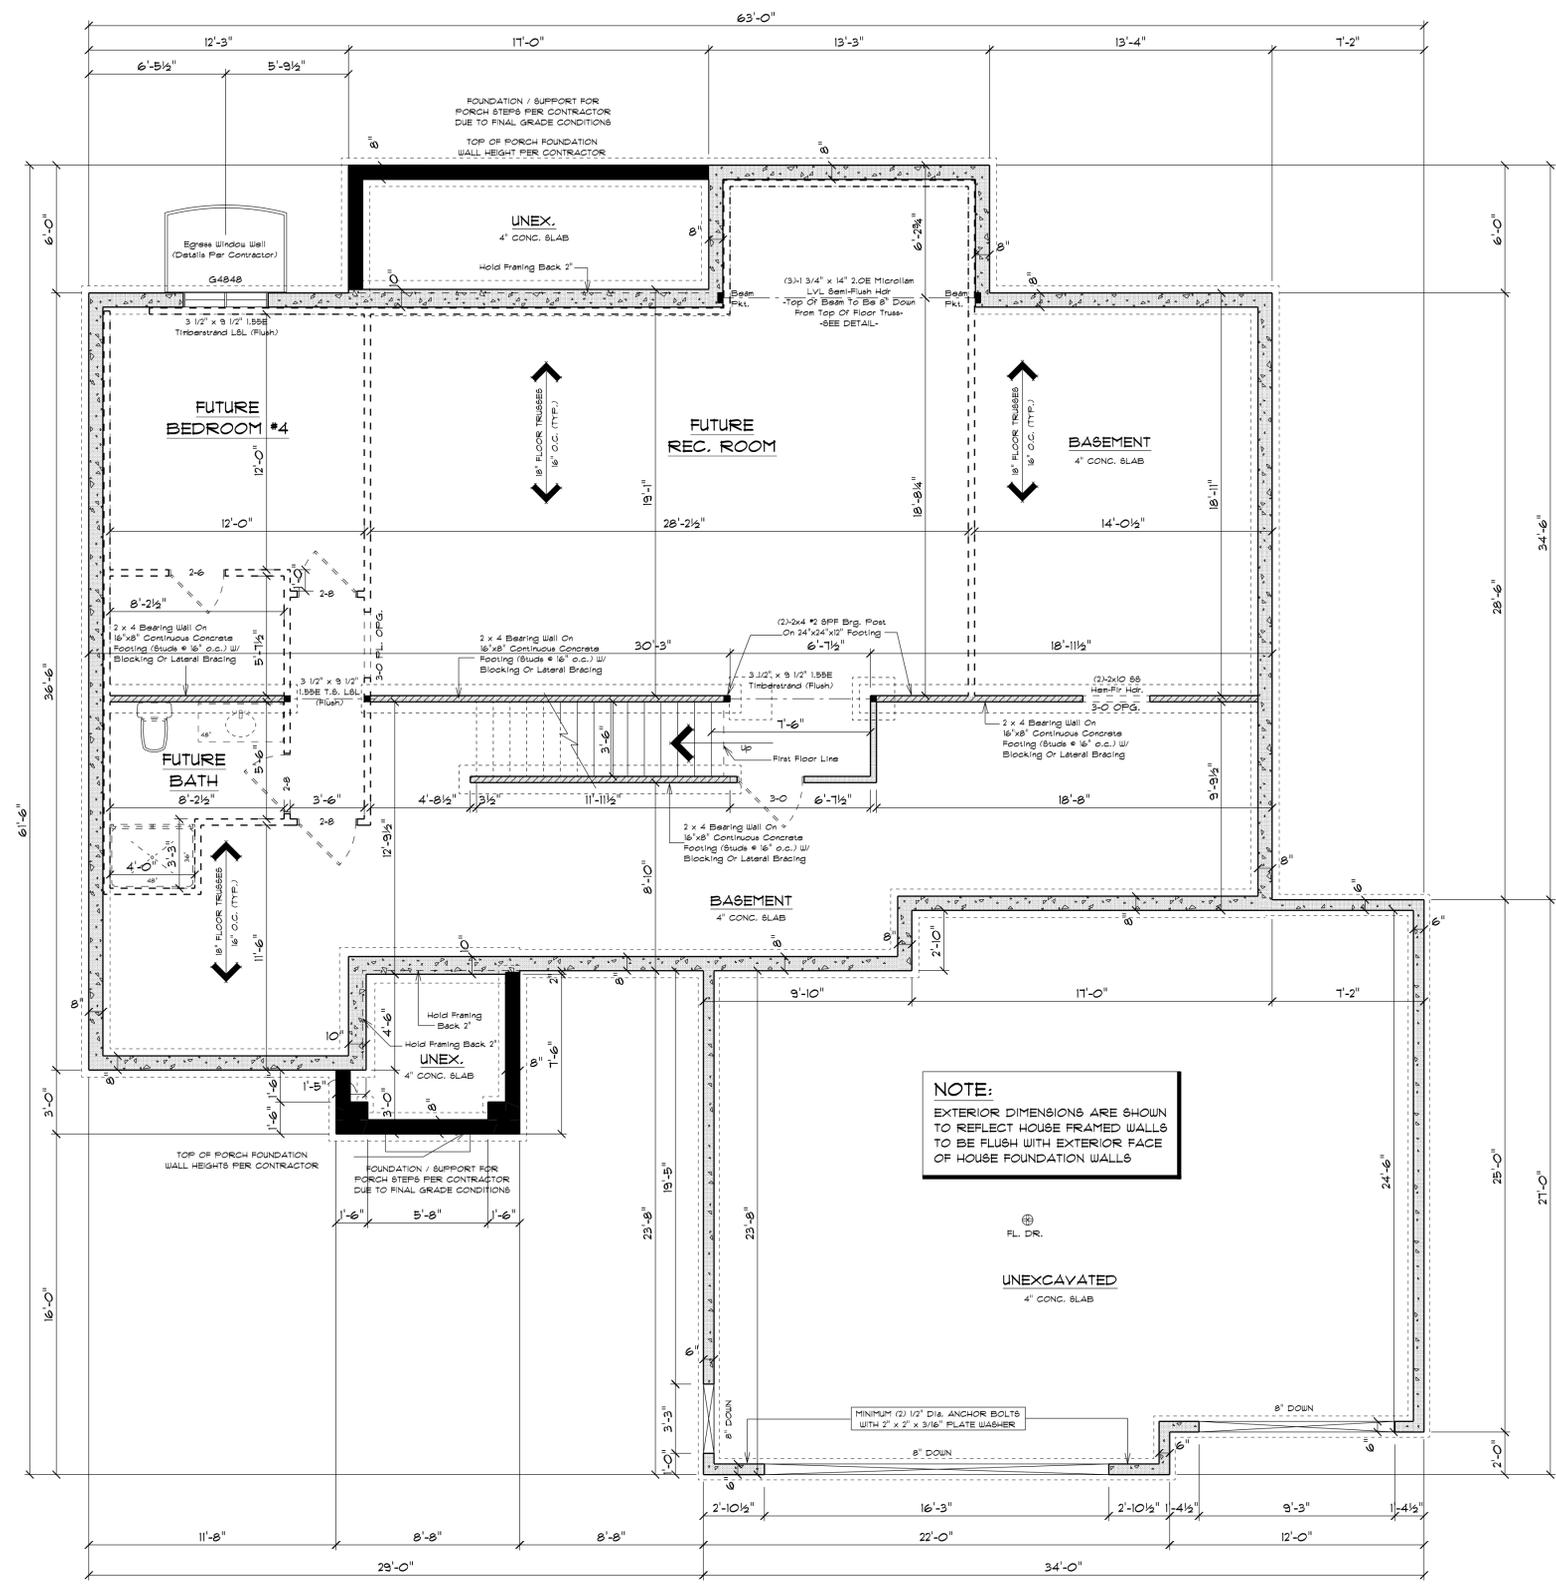

SQUARE FOOTAGE:

FIRST FLOOR:	1869
GARAGE:	854
COVERED PORCHES:	168
FUTURE FIN. BASEMENT:	950

PLAN SPECIFICATIONS:

- THE CONDITIONS LISTED BELOW ARE STANDARD FOR THIS PLAN ONLY - EXCEPTIONS ARE NOTED ON THE PLAN ITSELF
- WALL INFORMATION:**
 - HOUSE FOUNDATION: 8" x 8" POURED CONCRETE
 - GARAGE FOUNDATION: 6" x 4" POURED CONCRETE
 - POURCAFFO FOUNDATION: 8" POURED CONCRETE, MIN. 4'-0" TALL
 - HOUSE EXTERIOR: FIRST FLOOR: 2 x 4 x 8'-1 1/8" STUDS @ 16" O.C.
 - HOUSE INTERIOR: FIRST FLOOR: 2 x 4 x 8'-1 1/8" STUDS @ 16" O.C.
 - GARAGE: 2 x 4 x 8'-1 1/8" STUDS @ 16" O.C.
 - TALL WALLS ARE EXTERIOR WALLS WITH STUDS TALLER THAN 10'-0" AND NEED TO BE DESIGNED BY ENGINEERED WOOD PRODUCTS SUPPLIER
 - TAPERED WALLS ARE TO BE FRAMED TO UNDERSIDE OF SCISSOR ROOF TRUSSES
- STAIR INFORMATION:**
 - BASEMENT TO FIRST FLOOR: 15 RISERS @ 1 1/8" - 14 TREADS @ 9 1/2"
- FLOOR SYSTEM(S):**
 - BASEMENT: 4" REINFORCED CONCRETE SLAB
 - FIRST FLOOR: 18" FLOOR TRUSSES @ 16" O.C. STD. LOADING (PER SQ. FT.) 40# TOLL, 10# TOLL, 2# BCL ADDITIONAL LOADING (PER SQ. FT.): 10# TOLL FOR TILE FLOOR 2# TOLL FOR GRANITE DEFLECTION: LLL/480 DLI/240 DURATION OF LOAD: 100# FRAMER TO REFERENCE TRUSS LAYOUT PLANS TO VERIFY EXACT SIZE AND LOCATION OF ALL FLUSH HEADERS AND BEAMS IN FLOOR SYSTEM
- ROOF SYSTEM:**
 - ENGINEERED WOOD TRUSSES @ 24" O.C. DESIGNED FOR BROOK COUNTY - ZONE 2 STD. LOADING (PER SQ. FT.) 30# TOLL, 10# TOLL, 2# BCL DEFLECTION: LLL/240 DLI/180 DURATION OF LOAD: 18# FRAMER TO REFERENCE TRUSS LAYOUT PLANS TO VERIFY EXACT LOCATIONS OF GIRDER TRUSSES AND THEIR RESPECTIVE BEARING REQUIREMENTS & UPLIFT ANCHORING REQUIREMENTS
 - HEADERS:
 - STD. HEADERS: (2) 2X10 HEM-FIR SELECT STRUCTURAL WITH 2X PLAT
 - TOP OF WINDOW R.O.S.
 - FIRST FLOOR @ 6'-11 3/8" ABOVE SUBFLOOR
 - MINIMUM OF (2) TRIM STUDS AT EACH END FOR ALL OPENINGS 6'-0" AND LARGER
 - WINDOWS:
 - ALLIANCE VINYL WINDOWS
 - MANUFACTURER TO PROVIDE SUPPLIER WITH EXACT R.O. SIZES AND DETAILS. SUPPLIER TO VERIFY THAT ALL CODE REQUIREMENTS ARE MET.
- GENERAL INFORMATION:**
 - THE FOLLOWING ITEMS ARE TO BE LOCATED IN THE FOUNDATION BY THE GENERAL CONTRACTOR:
 - BASEMENT WINDOWS
 - FLOOR DRAINS
 - ELECTRIC SERVICES
 - WATER HEATER
 - BUMP PIT & PUMP
 - FURNACE
 - BUILDER TO PROVIDE HEADERS AT CONCRETE OPENINGS IF NOT NOTED ON THE FOUNDATION PLAN
 - POURED CONCRETE FOOTINGS TO BEAR ON UNDISTURBED SOIL BELOW THE FOOT LINE
 - STEEL COLUMNS TO SUPPORT 1000#
 - INTERIOR BEARING WALLS TO SIT ON CONTINUOUS CONCRETE FOOTINGS STUDS @ 16" O.C. WITH BLOCKING OR LATERAL BRACING
 - CONCRETE CONTRACTOR AND BUILDER ARE RESPONSIBLE TO DETERMINE SITE SOIL CONDITIONS AND FOLLOW STANDARDS PER 809.302.4. THE MOST RESTRICTIVE STANDARDS OF 809.302.5 - 809.302.8, ACI 318-14, AND ACI 308-14 FOR ALL FOOTINGS & WALL REINFORCEMENT. IF NEEDED, MUST BE FOLLOWED.
 - ASSUMED SOIL CAPACITY IS 3,000 PSF. FTG SIZES MUST BE ADJUSTED FOR VARYING SITE DETERMINED SOIL BEARING CONDITIONS
 - ALL LUMBER IN PERMANENT CONTACT W/ CONCRETE MUST BE PRESSURE TREATED LUMBER AS PER U/ 809.302.10 DUE TO UNKNOWN GRADE CONDITIONS. ACTUAL STEPS IN FOUNDATION WALLS AND LOCATION OF WINDOW WELLS TO BE DETERMINED ON SITE BY GENERAL CONTRACTOR
 - FRAMER IS RESPONSIBLE FOR TRANSFERRING POINT LOADS FROM ABOVE, THROUGH THE FLOOR SYSTEM(S) AND WALLS, W/ SOLID BLOCKING DOWN TO CONCRETE FOUNDATION WALLS BELOW
 - PLAN IS DRAWN ACCORDINGLY FOR 3/4" CASING
 - ALL DIMENSIONS SHOWN ARE FROM STUD TO STUD
 - BUILDER TO PROVIDE ATTIC SCUTTLE AND LOCATION
 - FIRE SEPARATION MUST BE PROVIDED BETWEEN HOUSE AND GARAGE (SEE CODE FOR DETAILS)
 - ALL CABINET LAYOUTS ARE CONCEPTUAL. CONSULT CABINET DESIGNER/ PROVIDER FOR EXACT SIZES AND LOCATIONS OF CABINETS, APPLIANCES, AND WINDOWS


NOTE:
EXTERIOR DIMENSIONS ARE SHOWN TO REFLECT HOUSE FRAMED WALLS TO BE FLUSH WITH EXTERIOR FACE OF HOUSE FOUNDATION WALLS

NOTE:
EXTERIOR DIMENSIONS ARE SHOWN TO REFLECT HOUSE FRAMED WALLS TO BE FLUSH WITH EXTERIOR FACE OF HOUSE FOUNDATION WALLS

FOUNDATION PLAN

SCALE: 1/4" = 1'-0"
8'-0" FOUNDATION WALL HGT.

NOTE:
EXTERIOR DIMENSIONS ARE SHOWN TO REFLECT HOUSE FRAMED WALLS TO BE FLUSH WITH EXTERIOR FACE OF HOUSE FOUNDATION WALLS.

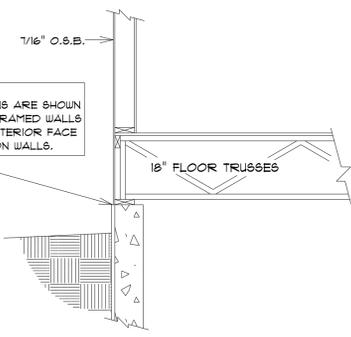

BOX SILL DETAIL
SCALE: 1/2" = 1'-0"

CUSTOMER DESIGNED FOR: **CRI Development**

JOB NAME: 2781 Sator Dr. (Lot 63) The Barfield
DATE: February 2, 2026
DRAWN BY: Ann Schuele
SCALE: 1/4" = 1'-0"
PLAN NO.: 26-028-R



IMPORTANT NOTE:
IT IS AGREED THAT ALTHOUGH EVERY EFFORT HAS BEEN MADE IN PREPARING AND CHECKING THESE PLANS FOR ACCURACY, THE GENERAL CONTRACTOR/OWNER MUST REVIEW ALL DIMENSIONS, DETAILS AND NOTES BEFORE BEGINNING ANY CONSTRUCTION AND IS HEREBY HELD RESPONSIBLE FOR ANY DISCOVERED DISCREPANCIES.
IT IS UNDERSTOOD THAT THE WISCONSIN SAFETY AND PROFESSIONAL SERVICES CODE AND LAYOUT DRAWINGS FOR FLOOR AND ROOF TRUSSES SHALL TAKE PRECEDENCE OVER THESE ARCHITECTURAL PLANS.

MAILING ADDRESS:
P.O. BOX 0001
GREEN BAY, WI 54307-0001


OFFICE:
LARSSEN ROAD
GREEN BAY, WI 54303
PHONE (920) 436-5080
FAX (920) 436-5078



SQUARE FOOTAGE:	
FIRST FLOOR:	1869
GARAGE:	854
COVERED PORCHES:	168
FUTURE FIN. BASEMENT:	950

TOTAL PERPENDICULAR SIDE LENGTH: 61'-6"
BRACING METHOD: CONTINUOUSLY SHEATHED
EXPOSURE CATEGORY: C
TOTAL PANEL LENGTH REQUIRED: 10'-1"
TOTAL PANEL LENGTH PROVIDED: 13'-3"

Interpolation of Table 321.25-J was Performed To Achieve Req'd Bracing Length

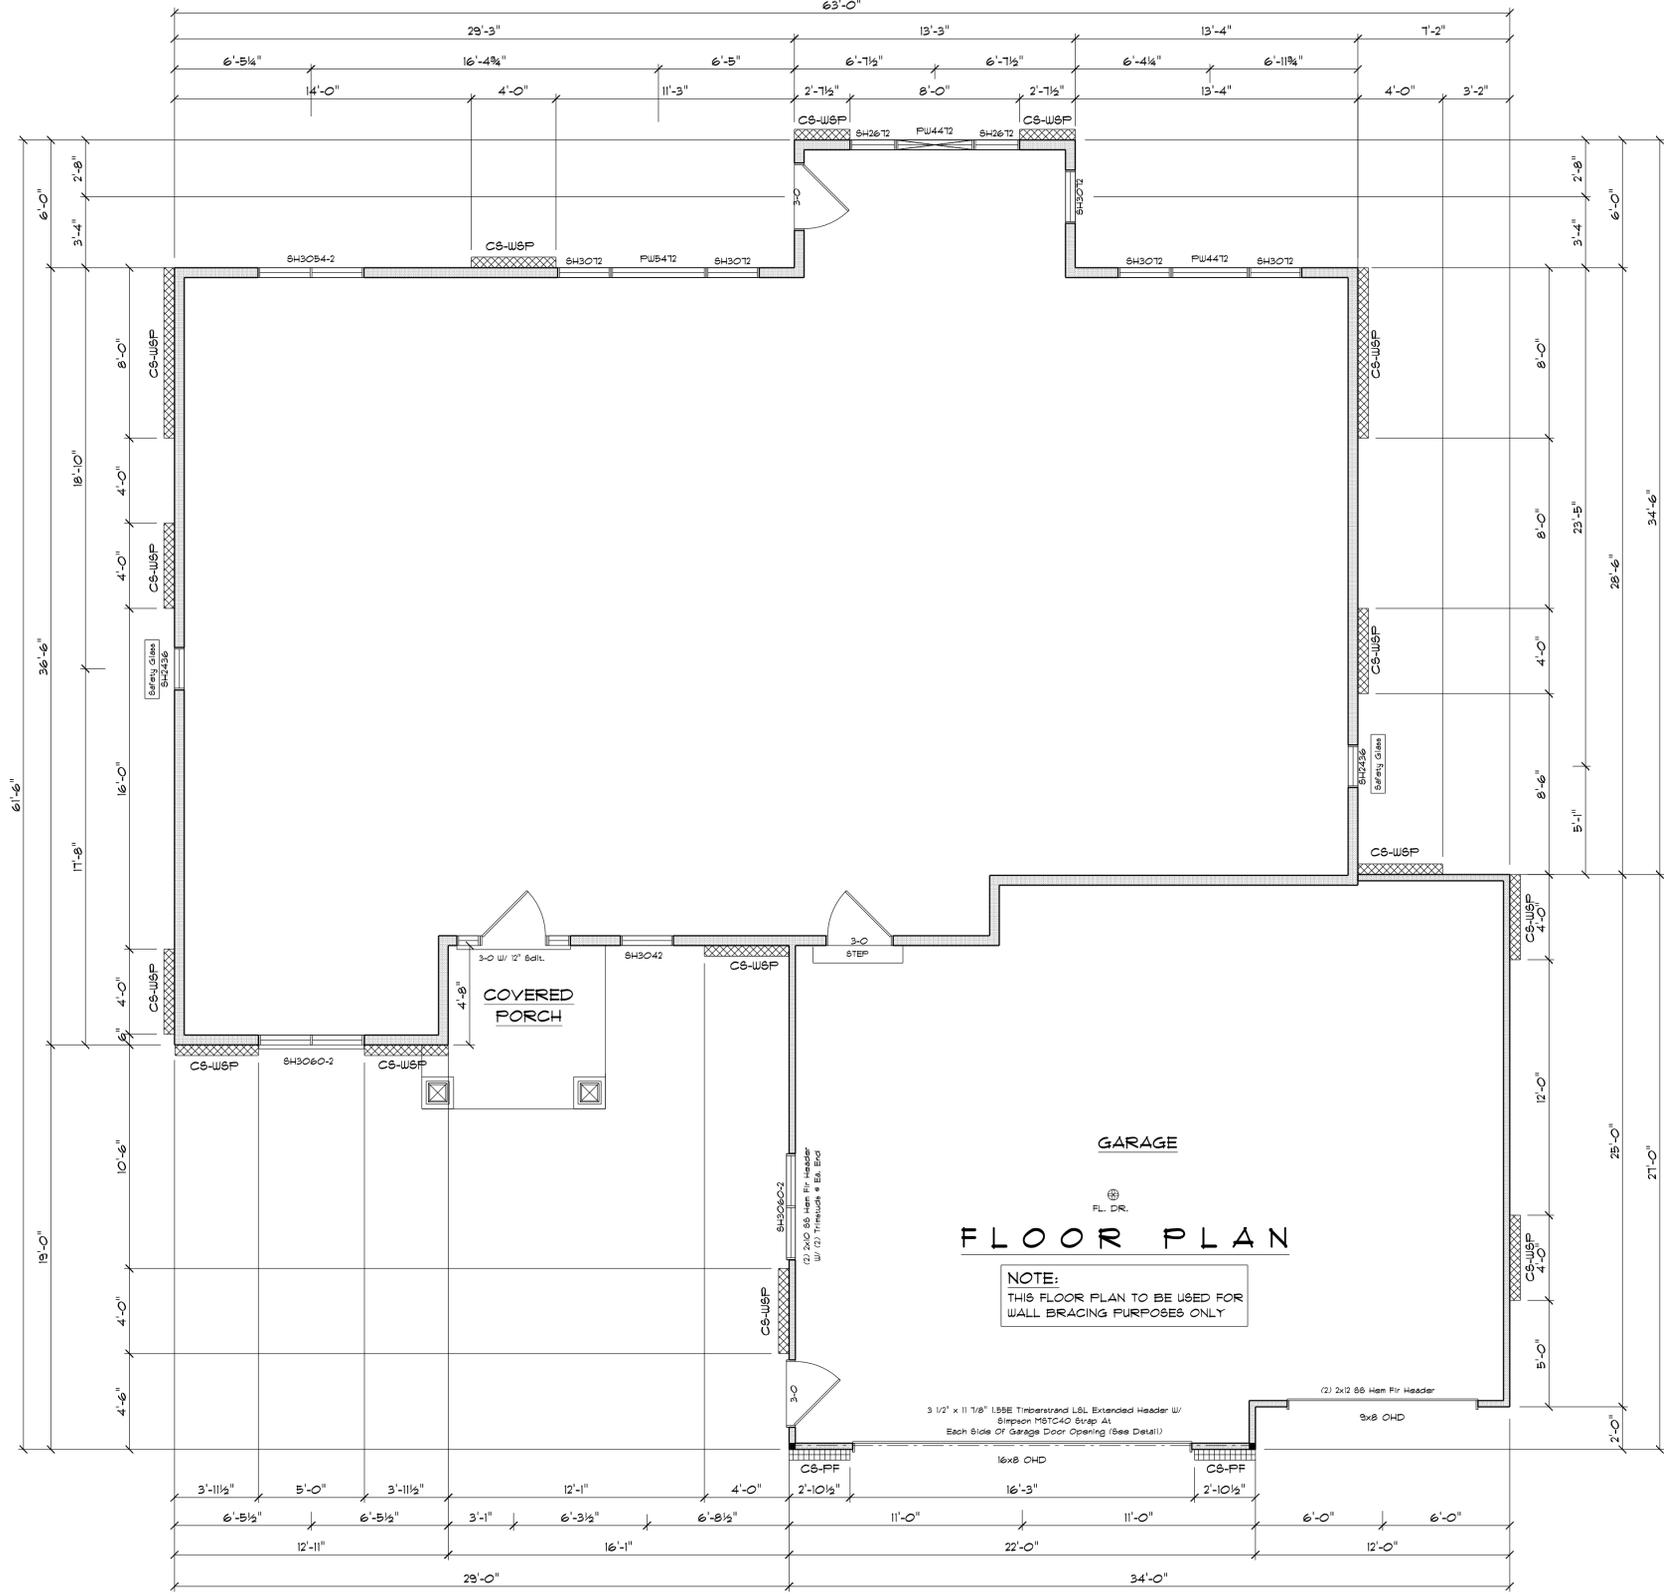

TOTAL PERPENDICULAR SIDE LENGTH: 61'-6"
BRACING METHOD: CONTINUOUSLY SHEATHED
EXPOSURE CATEGORY: C
TOTAL PANEL LENGTH REQUIRED: 10'-1"
TOTAL PANEL LENGTH PROVIDED: 13'-3"

Interpolation of Table 321.25-J was Performed To Achieve Req'd Bracing Length

TOTAL PERPENDICULAR SIDE LENGTH: 63'-0"
BRACING METHOD: CONTINUOUSLY SHEATHED
EXPOSURE CATEGORY: C
TOTAL PANEL LENGTH REQUIRED: 10'-1"
TOTAL PANEL LENGTH PROVIDED: 13'-3"

Interpolation of Table 321.25-J was Performed To Achieve Req'd Bracing Length

FLOOR PLAN

NOTE:
THIS FLOOR PLAN TO BE USED FOR
WALL BRACING PURPOSES ONLY

TOTAL PERPENDICULAR SIDE LENGTH: 61'-6"
BRACING METHOD: CONTINUOUSLY SHEATHED
EXPOSURE CATEGORY: C
TOTAL PANEL LENGTH REQUIRED: 11'-8"
TOTAL PANEL LENGTH PROVIDED: 11'-8"

Interpolation of Table 321.25-J was Performed To Achieve Req'd Bracing Length

WALL BRACING LAYOUT PLAN

Scale: 1/4" = 1'-0"
House Wall Ht.: 8'-1 1/8"
Garage Wall Ht.: 9'-9 3/8"
Top-Of-Wall-To-Ridge Ht.: 9'-7 3/4"
Exterior Stud Spacing: 16" O.C.
Seismic Design: B

GENERAL NOTES:

- WALL BRACING, SPS 321.25 (8)
- CIRCUMSCRIBED RECTANGLES: EACH FLOOR PLAN LEVEL SHALL BE CIRCUMSCRIBED WITH ONE OR MORE RECTANGLES AROUND THE ENTIRE FLOOR PLAN AT THE FLOOR LEVEL UNDER CONSIDERATION. WHEN MULTIPLE RECTANGLES ARE USED, EACH SIDE SHALL BE BRACED AS THOUGH IT WERE A SEPARATE BUILDING AND THE BRACING AMOUNT ADDED TOGETHER ALONG THE COMMON WALL WHERE ADJACENT RECTANGLES OVERLAP OR ABUT.
- BRACED WALL PANEL (BWP) LOCATIONS: WITHIN 12'-6" FROM EACH SIDE AND 21'-0" PANEL EDGE TO PANEL EDGE (SEE FIGURE 321.25-C).
- ALL EDGES OF PANEL TYPE BRACING, EXCEPT HORIZONTAL JOINTS IN GB BRACING, SHALL BE ATTACHED TO FRAMING OR BLOCKING.
- INTERIOR SIDE OF ALL EXTERIOR WALLS SHALL BE SHEATHED WITH MINIMUM 1/2" GYPSUM WALLBOARD UNLESS OTHERWISE PERMITTED TO BE EXCLUDED BY THIS SUBSECTION. (THIS REQUIREMENT IS EXCLUDED IN PORTAL FRAME METHOD).
- BRACING WITH CS-WSP SHALL HAVE SHEATHING INSTALLED ON ALL SHEATHABLE SURFACES ABOVE, BELOW, AND BETWEEN WALL OPENINGS.
- EACH BRACED WALL PANEL MAY CONTAIN NO MORE THAN ONE HOLE, HAVING A MAXIMUM DIMENSION OF NO MORE THAN TEN PERCENT OF THE LEAST DIMENSION OF THE PANEL, AND CONFINED TO THE MIDDLE THREE-FIFTHS OF THE PANEL.
- BLOCKING AND BRIDGING: 2x18 BRIDGING USED AT PARALLEL BOX SILL AND FLOOR JOIST BRIDGING (8" 3/4" O.C.) IS THE SAME DEPTH AS THE JOIST.
- WHERE JOISTS ARE PERPENDICULAR TO BWPS ABOVE OR BELOW, BLOCKING SHALL BE PROVIDED BETWEEN THE JOISTS AT BWP LOCATIONS TO PERMIT FASTENING OF WALL PLATES WITH 16d NAILS @ 16" O.C.
- WHERE JOISTS ARE PARALLEL TO BWPS ABOVE OR BELOW, A RIM JOIST OR OTHER PARALLEL FRAMING MEMBER SHALL BE PROVIDED AT THE BWP TO PERMIT FASTENING OF WALL PLATES WITH 16d NAILS @ 16" O.C.

WALL BRACING MATERIAL LEGEND


- CS-WSP (CONTINUOUSLY SHEATHED WOOD STRUCTURAL PANEL)
 - 2x8" THICK SHEATHING FOR MAX. 16" O.C. STUD SPACING
 - 1 1/8" THICK SHEATHING FOR MAX. 24" O.C. STUD SPACING
 - FASTEN WITH 6d COMMON NAILS OR 8d BOX NAIL, 2x3x8" LONG x 0.133" DIA. OR 1 1/4" x 12" CROWN NAIL GAGE STAPLES, 1 1/4" LONG HEAVY-DUTY FASTENER SPACING
 - 6" EDGES, 9" FIELD (NAILS) / 3" EDGES, 6" FIELD (STAPLES)
- CS-PF (CONTINUOUSLY SHEATHED PORTAL FRAME)
 - REFER TO FIGURE 321.25-A FOR SHEATHING FASTENER AND OTHER REQUIREMENTS.

TABLE 321.25-H a,b
MINIMUM WIDTHS OF CS-WSP BRACED WALL PANELS

MAXIMUM OPENING HEIGHT ADJACENT TO BRACED WALL PANEL	MINIMUM LENGTH OF FULL-HEIGHT BRACED WALL PANEL (INCHES)			
	8' TALL WALL	9' TALL WALL	10' TALL WALL	12' TALL WALL
5' - 4"	24	21	30	36
6' - 8"	32	30	30	36
7' - 2" (7' Gen. Dr.)	38	35	33	36
8' - 0"	48	41	38	36
8' - 2" (8' Gen. Dr.)	-	43	35	31
9' - 0"	-	54	46	41
10' - 0"	-	-	60	48
12' - 0"	-	-	-	72

a. SHEATHING SHALL EXTEND FROM TOP OF THE TOP PLATE TO THE BOTTOM PLATE AND MAY BE FULL-HEIGHT SHEETS. ALL JOINTS SHALL BE BLOCKED.
b. INTERPOLATION IS PERMITTED.

FIGURE 321.25-A
PF / CS-PF - PORTAL FRAME BRACE CONSTRUCTION

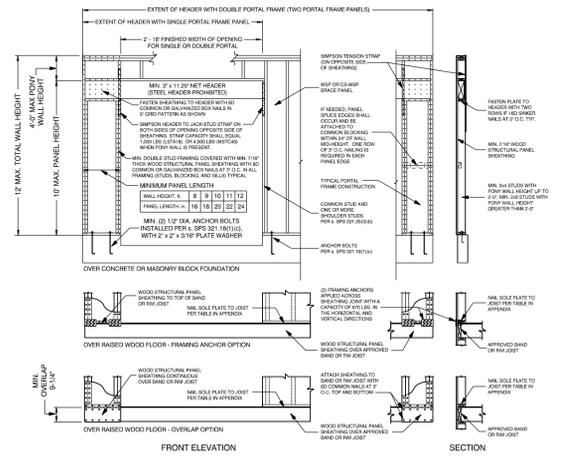

NOTE: STEEL HEADERS ARE PERMITTED IF DESIGNED BY STRUCTURAL ANALYSES.
NOTE: AS SHOWN IN THE ABOVE CROSS-SECTION, 1/2" OVERLAP WALL BOARD IS NOT REQUIRED ON THE EXTERIOR SIDE OF THE WALL.

CRI Development
JOB NAME: 2781 Stator Dr. (Lot 63)
DATE: February 2, 2026
DRAWN BY: Annie Schuele
CHECKED BY: [Blank]
SCALE: 1/4" = 1'-0"
PROJECT: 26-028-R



IMPORTANT NOTE:
IT IS AGREED THAT ALTHOUGH EVERY EFFORT HAS BEEN MADE IN PREPARING AND CHECKING THESE PLANS FOR ACCURACY, THE GENERAL CONTRACTOR/OWNER MUST REVIEW ALL DIMENSIONS, DETAILS AND NOTES BEFORE BEGINNING ANY CONSTRUCTION AND IS HEREBY HELD RESPONSIBLE FOR ANY DISCOVERED DISCREPANCIES.
IT IS UNDERSTOOD THAT THE WISCONSIN SAFETY AND PROFESSIONAL SERVICES CODE AND LAYOUT DRAWINGS FOR FLOOR AND ROOF TRUSSES SHALL TAKE FINAL PRECEDENCE OVER THESE ARCHITECTURAL PLANS.

MAILING ADDRESS:
P.O. BOX 10001
GREEN BAY, WI 54307-10001
OFFICE:
GREEN BAY, WI 54303
PHONE: (920) 436-5080
FAX: (920) 436-5084

